



iJRASET

International Journal For Research in
Applied Science and Engineering Technology



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Volume: 5

Issue: V

Month of publication: May 2017

DOI:

www.ijraset.com

Call: ☎ 08813907089

E-mail ID: ijraset@gmail.com

Application of Multi Evaporator Refrigeration System and Simulation

Arif O. Hannure

Assitant Professor, NKOCET Solapur

Abstract: *In many industrial and residential application, we require different temperature for different application, for example in office application one refrigeration system require at low temperature for chilling products at medium temperature, whereas one more system may require, which has somewhat higher temperatures compare to other for human comfort. To obtain such different temperature by normal single refrigeration system it is very difficult, as temperature requirement is different for different application but basic operation of cycle is same so, to follow economy, low initial cost, and operating cost it is essential to run a single refrigeration system with multi evaporator. In current research multi-evaporator system, with two evaporators is developed. These two evaporators are designed for two different temperatures. These two evaporators may be used for different application one is for refrigerator & another is for air conditioner. The arrangement is made to vary the load on evaporator by using electrical heater. The prime objective is to check the performance of system with variation in the temperature and load on the evaporator and simulate the system with Cool Pack software.*

Keywords: - Multi evaporator, combined refrigerator & air conditioner, cool pack, simulation.

I. INTRODUCTION

General refrigeration system is single evaporator system at one temperature. But many refrigeration installation, different temperature are required to be maintained at various points in the plant such as in hotels, large restaurants, institutions, industrial plants and food markets where the food products are received in large quantities and stored at different temperature. For example, the fresh fruit, fresh vegetables, cut meats, frozen products, dairy products, bottled goods, have all different conditions of temperatures and humidity for storage. In such cases each location is cooled by own evaporator in order to obtain more satisfactory control of the condition. For many industrial application, we require different temperature for different application, for example if we are using the refrigerator and air conditioner in the commercial space then we can get the cooling effect for storing the water bottles as well as the cooling effect for the human comfort. To obtain such different temperature by normal single refrigeration system is very difficult, as temperature requirement is different for different application, to follow economy, low initial cost and operating cost it is essential to run a single refrigeration system with multi evaporator. And simulation is useful tool to obtain the results of system in different operating conditions.

II. DESIGN OF SYSTEM

A. Deign of low temperature evaporator

It is recommended that the evaporator temperature should be kept 5°C below the temperature of the fluid to be cooled.

- Here let us consider the temperature of the fluid to be cooled as -10°C i.e. 263K.

- The design temperature of the evaporator = (263 – 5) = 258K

. Let us select an appropriate refrigerant for the evaporator temperature to be obtained.

A little consideration shows that R 404a is a good choice because it is having a boiling point of about -47°C (226 K). This is a commonly used refrigerant used in low temperature refrigeration. Calculation of Refrigeration effect-

Let's consider the low temperature evaporator is used to store milk chocolate having specific heat of 0.20 Btu/lb°F. mass of milk chocolate to be stored= 1 kg. Specific heat of chocolate (C_p) = 0.20 Btu/lb°F. = 0.46488 KJ/KgK

Let us consider an ambient temperature of 30°C (303 K) The milk chocolate is supposed to store at temperature of -10°C (263 K)

Hence temperature difference, $\Delta T = (303 - 263) \text{ K} = 40 \text{ K}$.

We can calculate the Refrigeration effect as

$$Q_D = m.C_p.\Delta T$$

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

$$= 1 \times 0.46488 \times 40$$

$$= 18.59 \text{ kJ.}$$

From p-h chart of R 404a,

Enthalpy $h_5 = 360 \text{ kJ/Kg}$. Enthalpy $h_4 = 260 \text{ kJ/Kg}$.

* Calculation of mass of the refrigerant flowing through the system (m)-

$$m_1 = \frac{Q_D}{q_c}$$

$$m_1 = \frac{Q_D}{(h_5 - h_4)}$$

$$m_1 = \frac{18.59}{(360 - 260)}$$

$$m_1 = 0.1859 \text{ kg.}$$

Evaporator tube selection- Copper tube is selected due to its good workability, high thermal conductivity, and corrosion resistance.

Selection of copper tube diameter is made 3/8" or 10 mm, as per manufacturer's suggestion.

Tube wall thickness is selected as 1 mm, as per manufacturer's suggestion.

Calculation of surface area of evaporator (A)- For this calculation we need the values of

ΔT_m = Log mean temperature difference (LMTD). and U = overall heat transfer coefficient.

LMTD is given as

$$LMTD = \frac{[(T_1 - T_L) - (T_2 - T_L)]}{\ln \left[\frac{(T_1 - T_L)}{(T_2 - T_L)} \right]}$$

where, T_L is the boiling temperature of the refrigerant and T_1, T_2 are temperatures of the milk chocolate before storage and final temperature of chock let respectively.

Here, T_L is boiling point of R 404a, (as we know that the refrigerant temperature should be 5°C less than that of the evaporator temperature i.e. 263 K) = 268 K .

For getting the values of T_1, T_2 let us decide ΔT .

$T_1 = 303 \text{ K}$ and $T_2 = 263$ so that $\Delta T = 40 \text{ K}$.

Thus, we can calculate

$$LMTD = \frac{[(303 - 258) - (263 - 258)]}{\ln \left[\frac{(303 - 258)}{(263 - 258)} \right]}$$

Thus, $\Delta T_m = 18.20 \text{ K}$

Thus, surface area of evaporator,

$$A = \frac{Q_D}{(\Delta T_m \cdot U)} \quad A = \frac{18.59}{18.20 \times 5}$$

$$A = 0.2042 \text{ m}^2$$

Calculation of length of Evaporator-

$$L = \frac{A}{\pi d} \quad L = \frac{0.2042}{(3.142 \times 0.01)}$$

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

$L = 6.49\text{m} = 21.29\text{ ft}$, say 21 ft.

B. Design of medium temperature evaporator

1) It is recommended that the evaporator temperature should be kept 5 K below the temperature of the fluid to be cooled.

- Here the temperature of Evaporator to be maintained is 273K.

- The design temperature of the evaporator = $(273 - 5)\text{ K}$
= 258 K.

2) It is quite obvious that refrigerant selected while designing the low temperature evaporator i.e. R-404a will serve the purpose in medium temperature evaporator also

3) Calculation of Refrigeration effect-

Let's consider the medium temperature evaporator is used to store vegetable let having specific heat of 0.29 Btu/lb^of. Vegetable to be stored = 1 kg.

Specific heat of vegetable (C_p) = 0.29 Btu/lb^of. = 1.172 KJ/KgK

Let us consider an ambient temperature of 30°C (303 K)

The vegetable is supposed to store at temperature of 0°C (273 K)

Hence temperature difference, $\Delta T = (303 - 273)\text{ K} = 30\text{ K}$.

We can calculate the Refrigeration effect as

$$Q_D = m.C_p.\Delta T$$

$$= 3 \times 1.172 \times 30$$

$$= 105.48\text{kJ}$$

From p-h chart of R 404a ,

Enthalpy $h_7 = 362\text{ kJ/Kg}$. Enthalpy $h_6 = 260\text{kJ/Kg}$.

* Calculation of mass of the refrigerant flowing through the system (m)-

$$m_2 = \frac{Q_D}{q_c}$$

$$m_2 = \frac{Q_D}{(h_7 - h_6)}$$

$$m_2 = \frac{105.48}{(362-260)}$$

$$= 1.034\text{ kg}.$$

4) Evaporator tube selection- Copper tube is selected due to its good workability, high thermal conductivity, and corrosion resistance.

Selection of copper tube diameter is made 3/8" or 10 mm, as per manufacturer's suggestion.

Tube wall thickness is selected as 1 mm, as per manufacturer's suggestion.

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

5) Calculation of surface area of evaporator (A)-

For this calculation we need the values of

ΔT_m = Log mean temperature difference (LMTD).

and U = overall heat transfer coefficient.

LMTD is given as

$$LMTD = \frac{[(T_1 - T_L) - (T_2 - T_L)]}{\ln \left[\frac{(T_1 - T_L)}{(T_2 - T_L)} \right]}$$

where, T_L is the boiling temperature of the refrigerant and T_1, T_2 are temperatures of the vegetable before storage and final temperature respectively.

Here, T_L is boiling point of R 404a, (as we know that the refrigerant temperature should be 5°C less than that of the evaporator temperature i.e. 273K) = 258 K.

For getting the values of T_1, T_2 let us decide ΔT .

$T_1 = 303$ K and $T_2 = 263$ so that $\Delta T = 40$ K.

Thus, we can calculate

$$LMTD = \frac{[(303 - 268) - (273 - 268)]}{\ln [(303 - 268) / (273 - 268)]}$$

Thus, $\Delta T_m = 15.41$ K

$$A = \frac{Q_D}{(\Delta T_m \cdot U)}$$

Thus, surface area of evaporator,

$$A = \frac{105.48}{(15.41 \times 50)} \quad A = 0.1388 \text{ m}^2$$

6. Calculation of length of Evaporator-

$$L = \frac{A}{\pi d} \quad L = \frac{0.1388}{(3.142 \times 0.01)}$$

$L = 4.35 \text{ m} = 14.27 \text{ ft}$, say 14 ft.

III. SIMULATION BY USING COOL PACK

COP of machine can be found out by using cool pack software:

A. Cool pack Approach

In the software simulation, some of the readings that taken actually on the machine are required to check the results obtained from the actual machine are ok or not. The cool pack gives us the direct calculations of the actual COP of the machine for the given pressure and the temperature. So that we can check that machine is working well or not.

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

File: C:\program files\coolpack\eescooltools\pack_2.exe (1)
EES Ver. 6.163: #955

12/2/2014 10:12:40 PM Page 1

CYCLE SPECIFICATION				
TEMPERATURE LEVELS		SUCTION GAS HEAT EXCHANGER	PRESSURE LOSSES	REFRIGERANT
$T_{E,HS}$ [°C]:	-1.0	No SGHX	$\Delta P_{SL,HS}$ [K]:	R134a
$T_{E,LS}$ [°C]:	2.0	LIQUID SUBCOOLER	$\Delta P_{SL,LS}$ [K]:	
T_C [°C]:	82.0	Thermal efficiency η_T [-]	ΔP_{DL} [K]:	
$\Delta T_{SH,HS}$ [K]:	1.0			
$\Delta T_{SH,LS}$ [K]:	1.0			
ΔT_{SC} [K]:	1.0			
CYCLE CAPACITY				
HS: Cooling capacity $\dot{Q}_{E,HS}$ [kW]	1.75	$\dot{Q}_{E,HS}$: 1.8 [kW]	\dot{m}_{HS} : 0.036 [kg/s]	$\dot{V}_{S,HS}$: 10.1 [m³/h]
LS: Cooling capacity $\dot{Q}_{E,LS}$ [kW]	1.75	$\dot{Q}_{E,LS}$: 1.8 [kW]	\dot{m}_{LS} : 0.011 [kg/s]	$\dot{V}_{S,LS}$: 3.1 [m³/h]
COMPRESSOR PERFORMANCE				
HS: Isentropic efficiency $\eta_{IS,HS}$ [-]	0.8	$\eta_{IS,HS}$: 0.800 [-]	\dot{W}_{HS} : 2.3 [kW]	\dot{W}_{TOT} : 3.1 [kW]
LS: Isentropic efficiency $\eta_{IS,LS}$ [-]	0.8	$\eta_{IS,LS}$: 0.800 [-]	\dot{W}_{LS} : 0.8 [kW]	
COMPRESSOR HEAT LOSS				
HS: Heat loss factor $f_{Q,HS}$ [%]	10	$f_{Q,HS}$: 10.0 [%]	T_2 : 108.3 [°C]	$\dot{Q}_{LOSS,HS}$: 0.2 [kW]
LS: Heat loss factor $f_{Q,LS}$ [%]	10	$f_{Q,LS}$: 10.0 [%]	T_{15} : 141.7 [°C]	$\dot{Q}_{LOSS,LS}$: 0.1 [kW]
SUCTION LINES				
HS: Heat ingress $\dot{Q}_{SL,HS}$ [W]	500.0	$\dot{Q}_{SL,HS}$: 500 [W]	T_9 : 15.3 [°C]	$\Delta T_{SH,SL,HS}$: 15.3 [K]
LS: Heat ingress $\dot{Q}_{SL,LS}$ [W]	500.0	$\dot{Q}_{SL,LS}$: 500 [W]	T_{14} : 54.6 [°C]	$\Delta T_{SH,SL,LS}$: 51.6 [K]
<input type="button" value="Calculate"/> <input type="button" value="Print"/> <input type="button" value="Help"/> <input type="button" value="Auxiliary"/> <input type="button" value="State Points"/> COP: 1.131 COP _{HS} : 1.378 COP _{LS} : 1.713				

Figure 2: Cycle generated by cool pack software

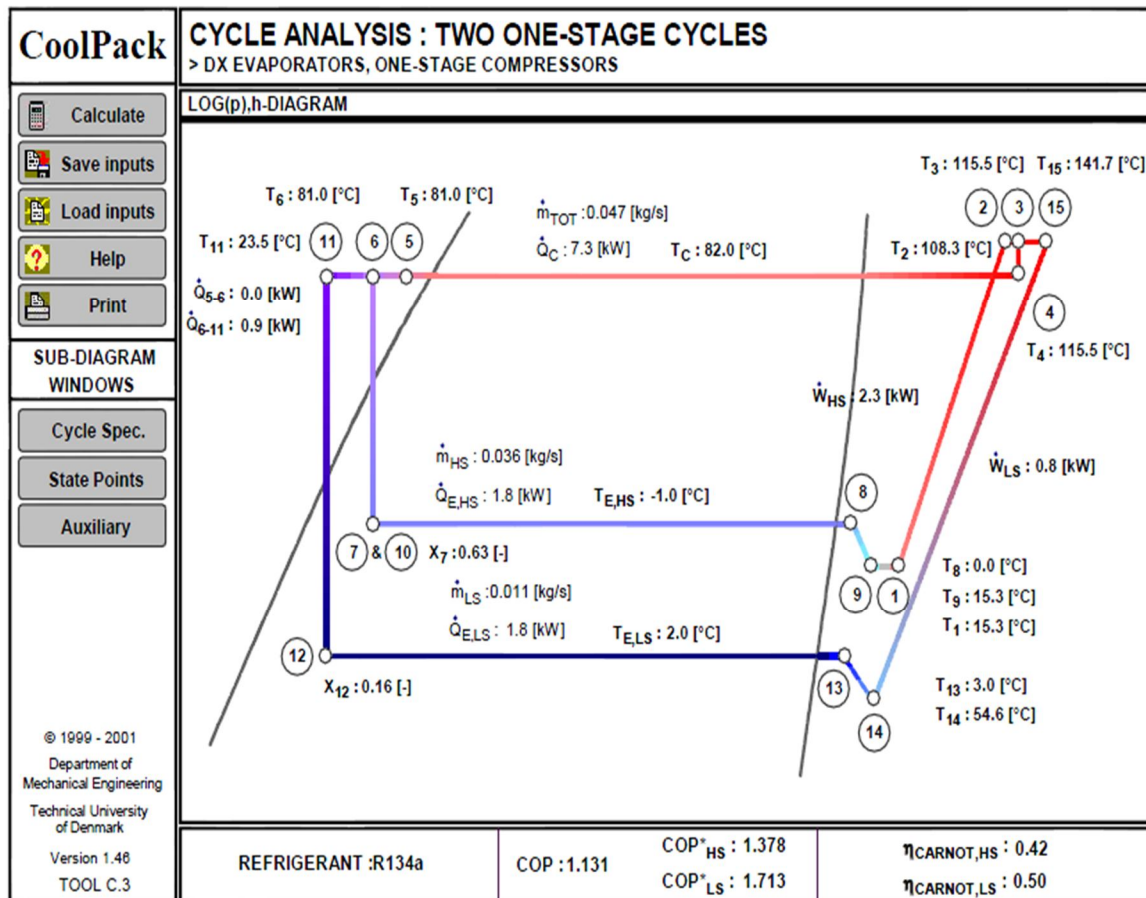



Figure 2: Cycle generated by cool pack software

IV. RESULTS AND DISCUSSION

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

Load,kW	Actual COP			Theoretical COP	Carnot COP
	By calculations	By Cool Pack	% Change	By calculations	By calculations
0.9	1.070	1.131	6.1	4.47	5.22
1.0	1.112	1.175	6.5	4.88	5.89
1.1	1.125	1.19	6.5	4.85	5.70
1.7	1.157	1.25	9.3	5.16	6.48
1.9	1.175	1.287	11.2	5.22	6.55
2.4	1.243	1.373	13	5.44	6.78


Table No.1 Result for COP with variation of load on system

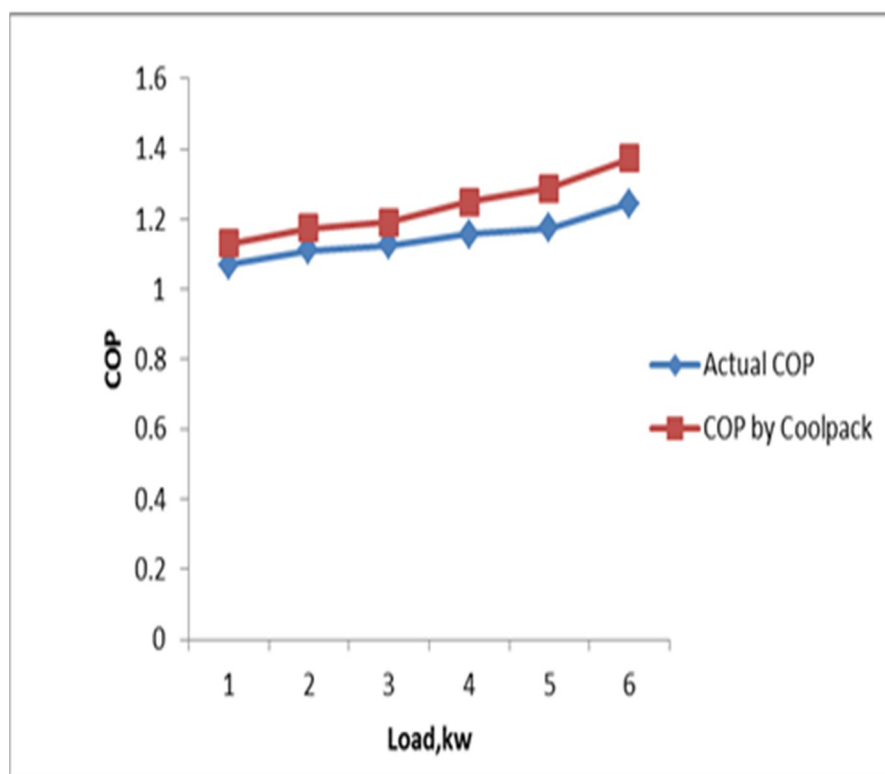

Graph No.1 Comparison of actual COP and COP by cool pack


Above graph no.1 shows that as the load on the evaporator increases the COP also increases. Rise in actual COP is observed from the load change from 0.9kW to 2.4kW.

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

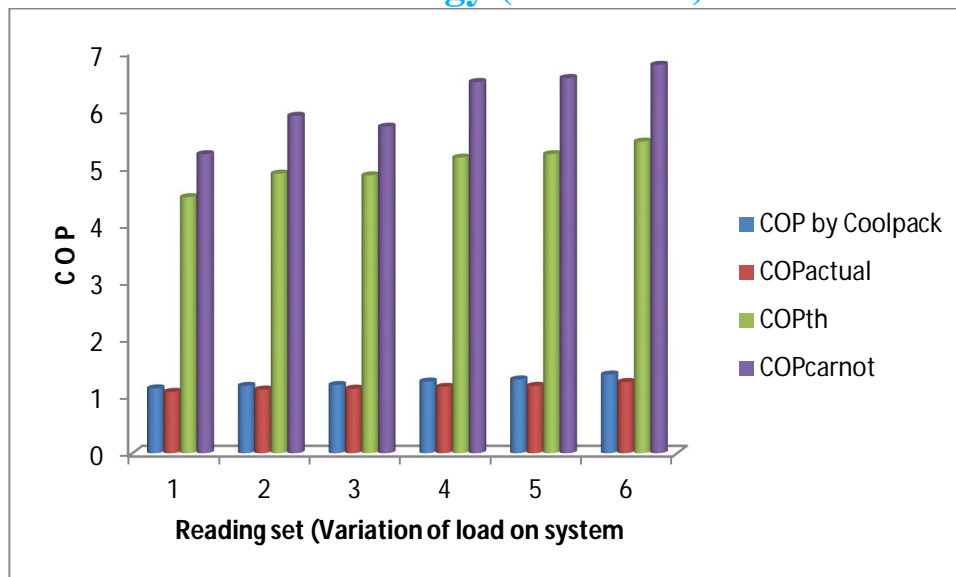

Graph No.2 Comparison of actual, theoretical and Carnot COP


Above graph no.4 shows the comparison of COP actual, COPth and COP Carnot. COP Carnot is greater than COP actual and COPth. COP actual varies from 1.07 to 2.43, COP theoretical varies from 4.47 to 5.44 and COP Carnot varies from 5.22 to 6.78.

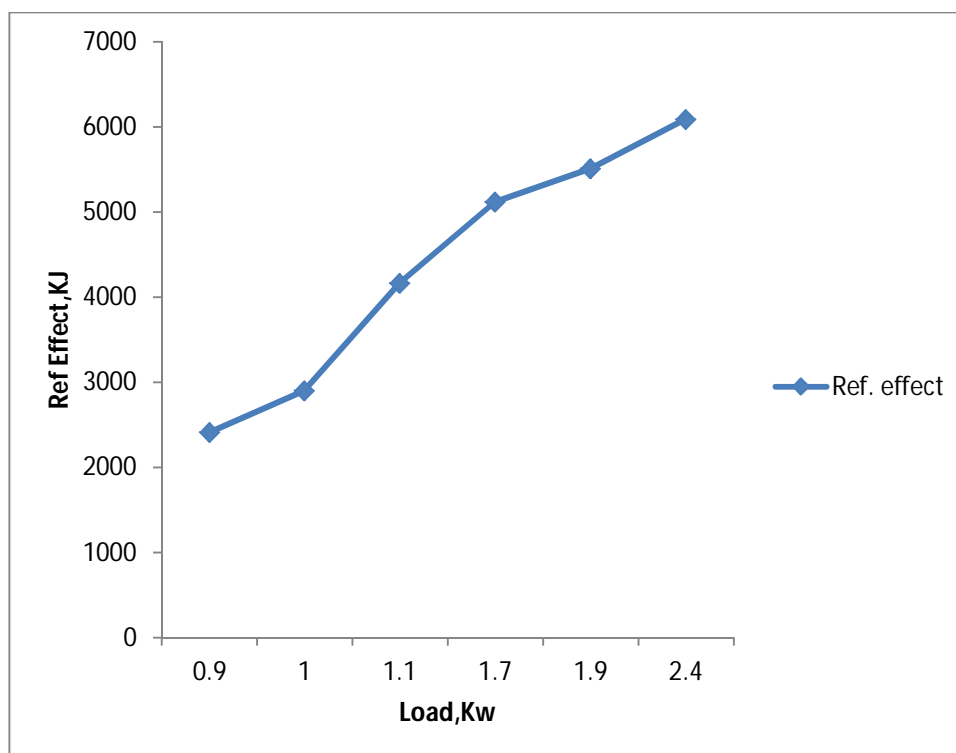

Graph No .3 Refrigerating effect

Above graph no.6 shows the refrigerating effect. Refrigerating effect increases because of its heat transfer coefficient increases. At higher load refrigerating effect is about 16% more but as load decreases refrigerating effect decreases.

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

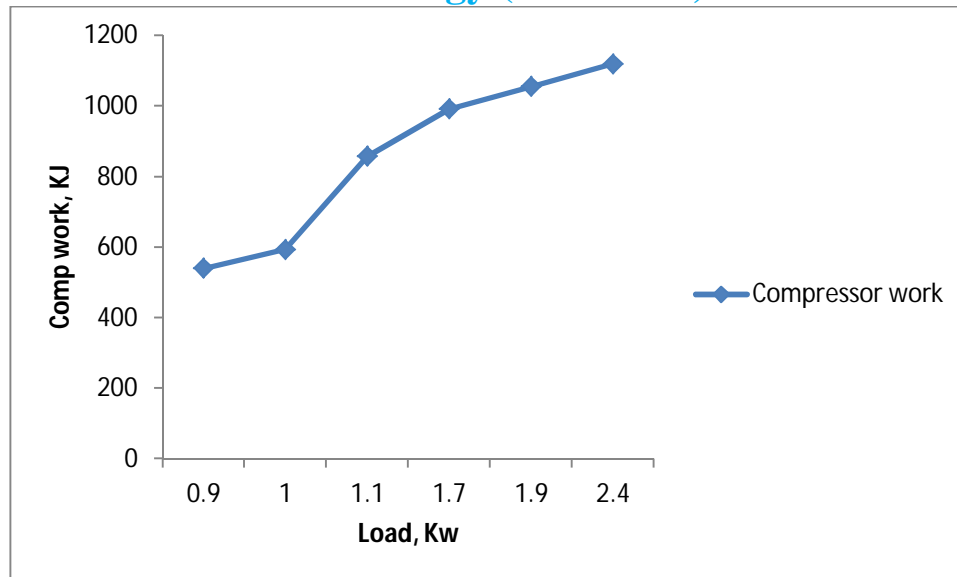

Graph No.4 Compressor work

Above graph no.6 shows compressor work. Compressor work is more it because of more pressure drop across evaporator so more compressor work required. At higher load up to 6.67% more work required.

V. COMPARISON OF RESULTS

A. *Following conclusion are made from the work carried out on effect of combined unit of VCR system.*

- 1) When system is operated at same loading conditions in individual mode and in combined mode, the actual COP increased about 1.27% to 7.28%, theoretical COP about 2.07% to 5.93% and Carnot COP 2.38% to 7.42%.
- 2) At the same when system simulate with Cool pack software results obtained are close to the actual output given by the combined unit, the difference in the results of actual output and simulation varies from 6% to 13%.
- 3) The main reason for the improved performance of this system in combined mode is due to reduction in compressor work and increase in refrigeration effect. Refrigerant effect also improved about 2% to 16%.
- 4) As the system is simulated with Cool Pack software, so we can get many output by varying the different parameters which will gives us very close results as that of actual working machine or system.
- 5)

VI. CONCLUSIONS AND SCOPE FOR FUTURE WORK

A. *Conclusions*

The current project work can be continued and thus has a scope for further of work. For this purpose, the following points can be considered with the same set-up. They are as follows-

- 1) There is scope for analyzing the system performance by using different feasible refrigerants.
- 2) Performance evaluation of the system can be performed at different ambient temperatures. For this purpose, change in the temperature of local ambient air should be done by artificial means.
- 3) Simulation of the system can be done by using various software's like Matlab etc., can be compared with experimental result.
- 4) Effect of heat transfer coefficient of refrigerant in evaporator can be studied.

REFERENCES

- [1] Cook R, "Air Cooler & refrigerator", US patent No.1716766, June 11, 1929.
- [2] Patrick E, "Combined Refrigerator & Air conditioner", US patent No. 3166912, January 26, 1965.
- [3] Ledbetter R, "Air conditioning refrigerator", US patent No. 4821530, April 18, 1989.
- [4] Sanaye S and Malekmohammadi H, "Thermal and economical optimization of air conditioning units with vapor compression refrigeration system", Applied Thermal Engineering 24 (2004) 1807-1825
- [5] Elliott M and Rasmussen B, "Model-Based Predictive Control of a Multi-Evaporator Vapor Compression Cooling Cycle" American Control Conference,

International Journal for Research in Applied Science & Engineering Technology (IJRASET)

Washington, USA (June 2008)

- [6] Hu T and Yoshino H, "Analysis on Energy Consumption and Indoor Environment in Kunming China" Sustainability 2012, Vol 4, 2574-2585
- [7] Afonso C, "Household refrigerators: Forced air ventilation in the compressor and its positive environmental impact", International Journal of Refrigeration", Vol.36 (2013) 904-912
- [8] Niro G, Salles D, Alcantara M, DaSilva L, "Large-scale control of domestic refrigerators for demand peak reduction in distribution systems" Electric Power Systems Research (2013) vol. 100 34– 42
- [9] Zhu Y, Jin X, Du Z, Fan B, Fu S, "Generic simulation model of multi-evaporator variable refrigerant flow air conditioning system" International Journal of Refrigeration", Vol.36 (2013) 1602-1615



10.22214/IJRASET



45.98



IMPACT FACTOR:
7.129



IMPACT FACTOR:
7.429



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24*7 Support on Whatsapp)