



# IJRASET

International Journal For Research in  
Applied Science and Engineering Technology



---

# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

---

**Volume: 8**

**Issue: II**

**Month of publication: February 2020**

**DOI:**

[www.ijraset.com](http://www.ijraset.com)

Call:  08813907089

E-mail ID: [ijraset@gmail.com](mailto:ijraset@gmail.com)

# The Environment Effect to Improve the Performance of Air Conditioning System by using Statistical Method

Dhanavath Dharma<sup>1</sup>, Sangepu Ganesh<sup>2</sup>

<sup>1, 2</sup>M. Tech, Swami RamanandaTirtha Institute Of Sciences & Technology

**Abstract:** *The environment effect to improve the performance of air conditioning system has been proposed. The optimum designed heat load, matching current changeable climatic conditions and providing efficient performance of air conditioning system with maximum annual refrigeration effect, has been defined as a result of statistical treatment of data sets of hourly refrigeration outputs year round. The air conditioning system and corresponding refrigeration capacity of refrigeration machine providing the maximum annual refrigeration capacity output and a value of stable heat load as designed basic heat load covered with high efficiency performance of refrigeration machine in nominal mode are calculated. The values of unstable heat loads as boost loads for ambient air pre cooling covered with low efficiency performance of refrigeration machine in partial modes that cause energetic losses are calculated by remainder principle as difference between optimum designed total refrigeration capacity, providing the maximum annual refrigeration output, and a value of stable heat load as designed basic heat load. The operation of refrigeration machine in partial modes needs application of energy conserving methods of air conditioning.*

**Index term:** *Statistical data, air conditioning system, air cooler, heat load, annual refrigeration capacity output, changeable climatic conditions.*

## I. INTRODUCTION

The improving performance of air conditioning systems and waste heat recovery refrigeration techniques explain on the reference [1-3]. The principal of technical innovation and methodological approaches in waste heat recovery refrigeration might be successfully applied for traditional vapor compression refrigeration technologies of air conditioning systems, in particular, two-stage air cooling, booster ambient air pre cooling by using an excessive refrigeration capacity accumulated at decreased heat loads to cover peak heat loads [4–6]. The enlarging duration of efficient performance of vapor-compression refrigeration machines of air conditioning systems at nominal or closed to nominal heat loads are the most attractive reserves of enhancing their energetic efficiency. The optimal design heat loads on air conditioning systems, i.e. optimal installed compressor refrigeration capacities, and the irrational distribution matching current changeable environment conditions and providing maximum annual refrigeration effect.

The proposed analysis is to improve the efficiency of air conditioning system performance in changeable environmental conditions by defining the optimal design heat load matching current climatic conditions through statistical treatment of data sets of hourly refrigeration outputs year round to find a maximum annual refrigeration output.

## II. STATISTICAL RESULTS

The performance efficiency of air conditioning systems and their vapor-compression refrigeration machines depends on duration of their operation year round and can be estimated by annual refrigeration output. The longer duration of air conditioning system refrigeration machine operation year round, the larger annual refrigeration output generated, and both of them are the results of designed heat loads selected closer to the current heat loads corresponding to changeable climatic conditions.

The values of annual refrigeration output in ratio value as total annual refrigeration output  $\Sigma(Q_0 \cdot t_1)$ , kW·h, related to unite of air mass flow:  $\Sigma(Q_0 \cdot t_1) / G_a$ , or  $\Sigma(q_0 \cdot t_1)$ , kW·h/(kg/s), where  $Q_0$  – refrigeration capacity, kW;  $t_1$  – time

duration, h;  $G_a$  – air mass flow in air cooler, kg/s, in dependence on designed specific refrigeration capacity  $q_0 = Q_0 / G_a$ , kW/(kg/s), related to unit air mass flow  $G_a = 1$  kg/s, of installed refrigeration machine for temperatures of cooled air  $t_{a2} = 10, 15$  and  $20$  °C and climatic conditions of Nikolaev region, Ukraine, 2015 year, are presented in Fig. 1


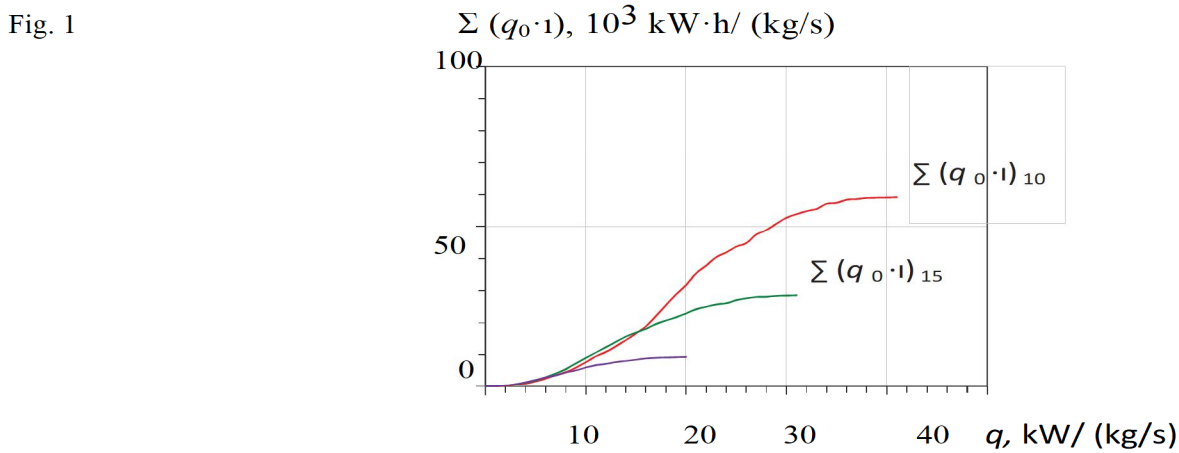



Figure 1 the results of statistical treatment of annual refrigeration output

In ratio values  $\Sigma (q_0 \cdot t)$  (at air mass flow  $G_a = 1$  kg/s) against designed specific refrigeration capacity  $q_0 = Q_0 / G_a$  of installed refrigeration machine for temperatures of cooled air  $t_{a2} = 10, 15$  and  $20$  °C:  $\Sigma (q_0 \cdot t)_{10}$  – at  $t_{a2} = 10$  °C;  $\Sigma(q_0 \cdot t)_{15}$  – at  $t_{a2} = 15$  °C;  $\Sigma(q_0 \cdot t)_{20}$  – at  $t_{a2} = 20$  °C

Because of sharply falling rate of annual refrigeration output increments  $\Sigma (q_0 \cdot t)_{10}$  the further increase in specific refrigerating capacity  $q_0$  from 34 to 40 kW/ (kg/s) does not result in appreciable increment in the annual refrigeration output  $\Sigma (q_0 \cdot t)_{10}$ . At the same time the further increase in refrigeration capacity  $q_0$  of installed refrigeration machine causes considerable increase in its capital expenses by 20...30 %. Thus, the specific refrigeration capacity  $q_0 = 34$  kW/(kg/s) is considered as rational one to calculate a total refrigeration capacity  $Q_0$  of installed refrigeration machine according to the total air mass flow  $G_a$ , kg/s:  $Q_0 = G_a \cdot q_0$ , kW. To prove a methodological approach to define the optimum designed heat load, matching current changeable climatic conditions, the values of specific refrigeration capacity  $q_{0,10}$  – for cooling ambient air from  $t_{amb}$  to  $t_{a2} = 10$  °C, specific refrigeration capacities  $q_{0,15}$  – for pre cooling ambient air from  $t_{amb}$  to intermediate temperature  $t_{a2} = 15$  °C and  $q_{0,20}$  – for pre cooling ambient air from  $t_{amb}$  to intermediate temperature  $t_{a2} = 20$  °C, corresponding specific Refrigeration capacities  $q_{0,10-15} = q_{0,10} - q_{0,15}$  for sub cooling air from  $t_{a2} = 15$  °C to  $t_{a2} = 10$  °C and  $q_{0,10-20} = q_{0,10} - q_{0,20}$  for sub cooling air from  $t_{a2} = 20$  °C to  $t_{a2} = 10$  °C have been calculated for climatic conditions in Nikolaev region for (Fig. 2).

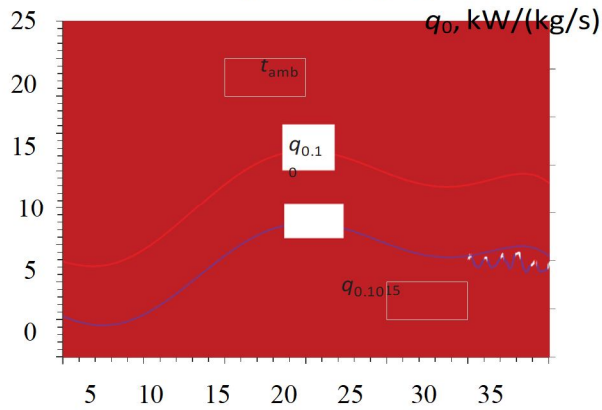

(a)

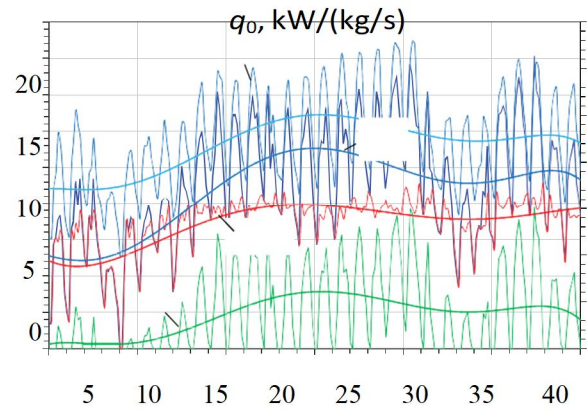

(b)



Figure 2. Current values of ambient air temperature  $t_{amb}$ , specific refrigeration capacity  $q_{0.10}$  for cooling ambient air from  $t_{amb}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$ , specific refrigeration capacity  $q_{0.15}$  for pre cooling ambient air from  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$  and specific refrigeration capacity  $q_{0.10-15} = q_{0.10} - q_{0.15}$  for deep sub cooling air from  $t_{a2} = 15\text{ }^{\circ}\text{C}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$  (a) and specific refrigeration capacity  $q_{0.20}$  for pre cooling ambient air from  $t_{amb}$  to the intermediate temperature  $t_{a2} = 20\text{ }^{\circ}\text{C}$  and corresponding specific refrigeration capacity  $q_{0.10-20} = q_{0.10} - q_{0.20}$  for sub cooling air from  $t_{a2} = 20\text{ }^{\circ}\text{C}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$  (b) for July 2015

As Fig. 2(a) shows, with pre cooling of the ambient air from  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$  the fluctuations in the current heat load  $q_{0.15}$  on the air cooler of the air conditioning system, i. e. in the current refrigeration capacity of the compressor for refrigeration machine, are very significant. This is caused by daily changes in the temperature  $t_{amb}$  and relative humidity  $_{amb}$  of ambient air with decreasing the temperature  $t_{amb}$  at night to  $15\text{ }^{\circ}\text{C}$  and lower with corresponding drops of the heat load  $q_{0.15}$  on the air cooler to zero. Such significant changes in the current heat loads  $q_{0.15}$  on the air cooler of air conditioning system, i. e. in the current refrigeration capacity of the compressor for refrigeration machine  $q_{0.15}$ , point out a large amount of an excessive refrigeration output in the temperate temperature hours of day round. Significant changes in the refrigeration capacity of the refrigeration machine compressor according to a wide range of changeable heat loads is followed by a decrease in its effective and electrical efficiency, and by an increase in the specific work of compression and electric energy consumption per at the same time, when air is being sub cooled in a stable temperature range from  $t_{a2} = 15\text{ }^{\circ}\text{C}$  to the temperature  $t_{a2} = 10\text{ }^{\circ}\text{C}$ , the fluctuations in the heat load on air cooler of air conditioning system  $q_{0.10-15} = q_{0.10} - q_{0.15}$  are relatively small:  $q_{0.10-15} = 11...13\text{ kW}/(\text{kg/s})$ . Thus, the behavior of the heat load on the air cooler of air conditioning system is different: significant changes in the heat load  $q_{0.15}$  for pre cooling of the ambient air from temperature  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$  and a relatively stable heat load  $q_{0.10-15}$  for sub cooling of air from  $t_{a2} = 15\text{ }^{\circ}\text{C}$  to temperature  $t_{a2} = 10\text{ }^{\circ}\text{C}$  (Fig. 2a). The less fluctuations of the current heat load on the air cooler, i.e. the closer the selected designed heat load on the air cooler to the relatively stable part of the current heat load, the lower energy losses caused by the operation of the compressor refrigeration machine in partial modes. Obviously, the range of refrigeration capacity controlling according to heat load can be narrowed by sharing the current heat load range on the air cooler in two parts: the relatively stable basic part of it,  $q_{0.10-15} = q_{0.10} - q_{0.15} = 11...13\text{ kW}/(\text{kg/s})$  while sub cooling air from  $t_{a2} = 15\text{ }^{\circ}\text{C}$  to the temperature  $t_{a2} = 10\text{ }^{\circ}\text{C}$ , and it's extremely unstable part  $q_{0.15}$  of pre cooling of the ambient air from its current temperature  $t_{amb}$  to an intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$ .

So, with regards to relatively stable heat load  $q_{0.10-15}$  for sub cooling air from  $t_{a2} = 15\text{ }^{\circ}\text{C}$  to the temperature  $t_{a2} = 10\text{ }^{\circ}\text{C}$  as compared with extremely unstable heat load  $q_{0.15}$  for pre cooling air from the ambient temperature  $t_{amb}$  to intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$ , the stable heat load value  $q_{0.10-15}$  is chosen as designed basic stable part  $q_{0.10-15} = q_{0.10} - q_{0.15}$  of the total heat load  $q_0 = 34\text{ kW}/(\text{kg/s})$  on the whole air cooler of air conditioning system defined according to the maximum annual refrigeration capacity generation (Fig. 1). The total unstable current heat load  $q_{0.10}$  for cooling ambient air from the changeable current ambient temperature  $t_{amb}$  to the temperature  $t_{a2} = 10\text{ }^{\circ}\text{C}$  can be covered by two stage ambient air cooling: air pre cooling by using boost specific refrigeration capacity (to cover changeable current heat load)  $q_{0.10}$  and air deep sub cooling by using basic refrigeration capacity to cover a relatively stable heat load  $q_{0.10-15}$  (Fig. 3a). But with this the correspondingly widened basic range of refrigeration capacity for deep sub cooling air is to remain still stable for the same climatic conditions.

If the ambient air is pre cooled from the changeable current ambient temperature  $t_{amb}$  to the higher intermediate temperature  $t_{a2} = 20\text{ }^{\circ}\text{C}$  (instead of  $t_{a2} = 15\text{ }^{\circ}\text{C}$ ), the refrigeration capacity  $q_{0.10-20} = q_{0.10} - q_{0.20}$  for deep sub cooling air from  $t_{a2} = 20\text{ }^{\circ}\text{C}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$  is not already stable. This is due to transference of heat load fluctuations from the boost air pre cooling range to the air sub cooling range that is caused by daily ambient air temperature  $t_{amb}$  decreasing lower  $20\text{ }^{\circ}\text{C}$  with corresponding drops in the boost heat load  $q_{0.20}$  for air pre cooling to zero leading to lowering the air sub cooling heat load range to  $q_{0.10-20} = 5...10\text{ kW}/(\text{kg/s})$  during 1-8 days against  $q_{0.10-20} = 15...20\text{ kW}/(\text{kg/s})$  in the rest of July (Fig. 3b).

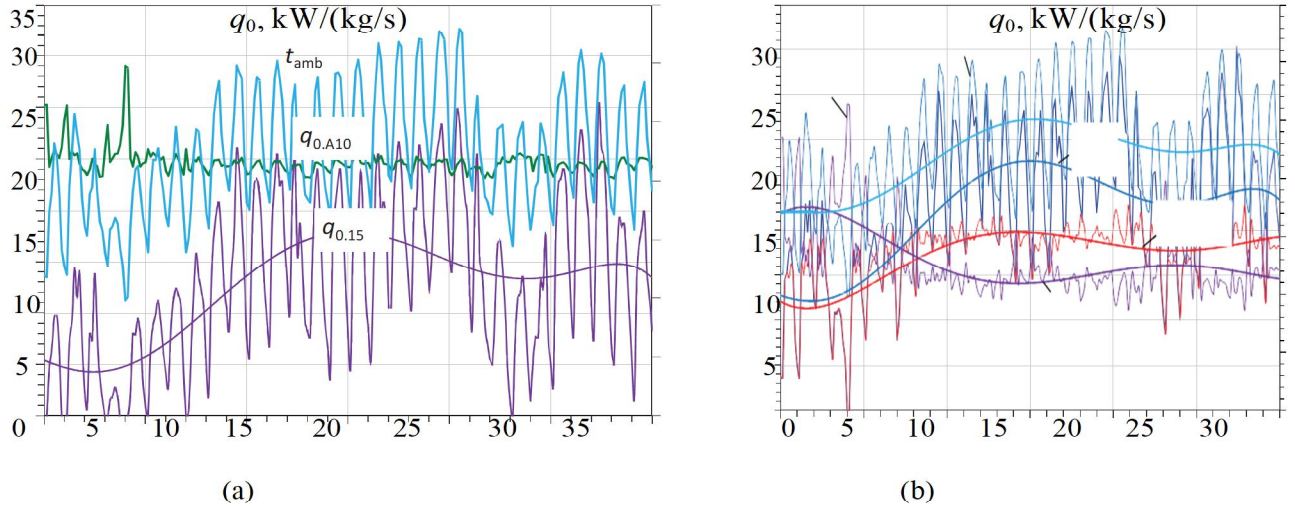


Figure: 3. Current values of ambient air temperature  $t_{amb}$ , changeable current heat loads  $q_{0.10}$  caused by cooling ambient air from current temperature  $t_{amb}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$  and covered by boost specific refrigeration capacity  $q_{0,A10} = 34 - q_{0.10-15}$  for pre cooling ambient air from  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$  and by basic specific refrigeration capacity  $q_{0.10-15} = q_{0.10} - q_{0.15}$  for sub cooling air from  $t_{a2} = 15\text{ }^{\circ}\text{C}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$  (a) and corresponding values of boost specific refrigeration capacity  $q_{0,A10-20} = 34 - q_{0.10-20}$  for pre cooling ambient air from  $t_{amb}$  to the intermediate temperature  $t_{a2} = 20\text{ }^{\circ}\text{C}$  and basic specific refrigeration capacity  $q_{0.10-20} = q_{0.10} - q_{0.20}$  for sub cooling air from  $t_{a2} = 20\text{ }^{\circ}\text{C}$  to  $t_{a2} = 10\text{ }^{\circ}\text{C}$  (b) in July 2015.

A designed rest boost specific refrigeration capacity  $q_{0,A10} = 34 - q_{0.10-15}$  generally covers current heat loads  $q_{0.15}$  for pre cooling the air from the ambient temperature  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$ , except some the warmest quite short periods of daytime (Fig.4a). But if the ambient air is pre cooled from the temperature  $t_{amb}$  to the higher intermediate temperature  $t_{a2} = 20\text{ }^{\circ}\text{C}$  (instead of  $t_{a2} = 15\text{ }^{\circ}\text{C}$ ), there is a large excess of boost refrigeration output  $q_{0,A10-20} = 34 - q_{0.10-20}$  as compared with current boost values  $q_{0.20}$  required for pre cooling ambient air from the temperature  $t_{amb}$  to the higher intermediate temperature  $t_{a2} = 20\text{ }^{\circ}\text{C}$  (Fig.4b).


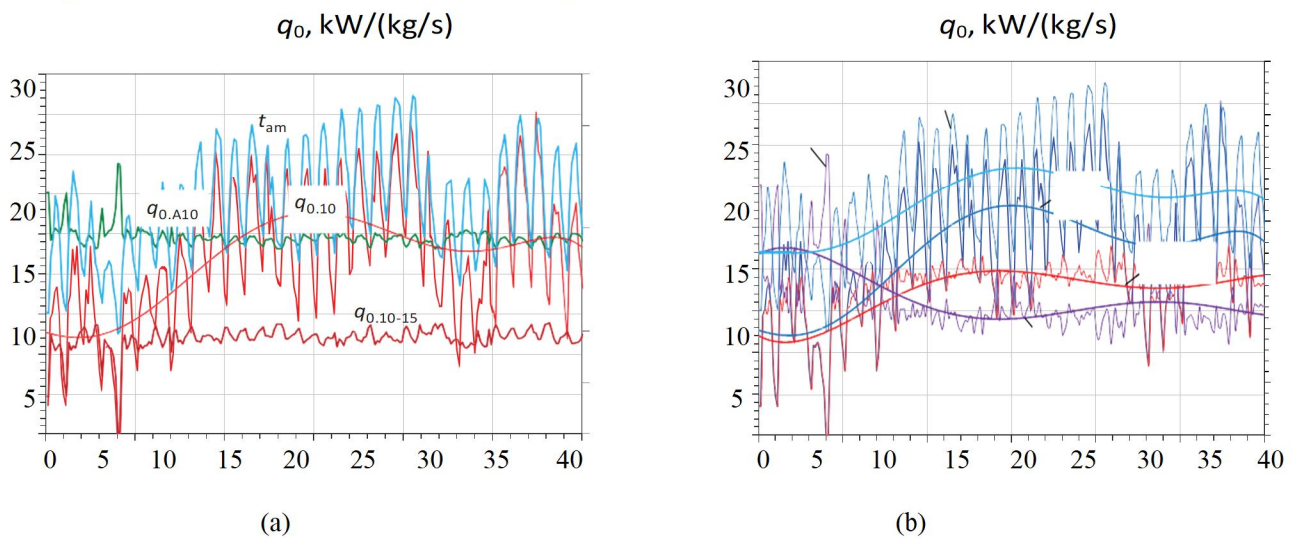


Figure: 4. Current values of ambient air temperature  $t_{amb}$ , changeable current heat load  $q_{0.15}$  for pre cooling ambient air from the current temperature  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15\text{ }^{\circ}\text{C}$  covered by boost specific refrigeration capacity  $q_{0,A10} = 34 - q_{0.10-15}$  (a) and corresponding values of  $q_{0.20}$  and  $q_{0,A10-20} = 34 - q_{0.10-20}$  for pre cooling ambient air from the current temperature  $t_{amb}$  to intermediate temperature  $t_{a2} = 20\text{ }^{\circ}\text{C}$  (b) in July 2015



Because of designed specific refrigeration capacity  $q_{0.10} = 34 \text{ kW}/(\text{kg/s})$  is chosen a bit less than maximum annual refrigeration output  $\Sigma(q_{0.10})_{10}$  to provide a high rate of arising the annual refrigeration capacity output  $\Sigma(q_{0.10})_{10}$  (Fig.1) it is necessary to check refrigeration capacity deficits for covering current heat loads:  $Oq_{0.10d} = q_{0.10} - 34 \text{ kW}/(\text{kg/s})$  and  $Oq_{0.15d} = q_{0.15} - 24 \text{ kW}/(\text{kg/s})$  and  $Oq_{0.20d} = q_{0.20} - 10 \text{ kW}/(\text{kg/s})$  (Fig.5).

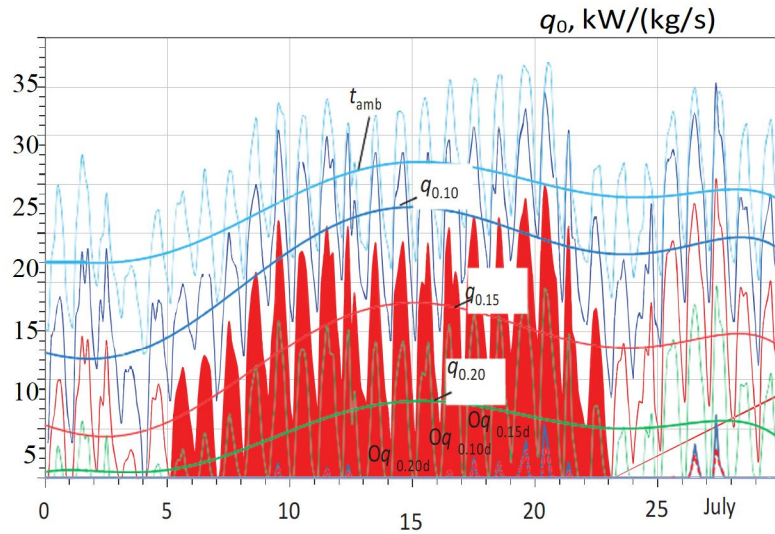

As one can see, there is no practically any deficit of design boost refrigeration capacity  $Oq_{0.20d}$  for pre cooling ambient air to the intermediate temperature  $t_{a2} = 20^\circ\text{C}$ , but a large excess of design boost refrigeration capacity  $q_{0.10-20} = 34 - q_{0.10-20}$  as compared with current boost heat load values  $q_{0.20}$  required for pre cooling ambient air from  $t_{amb}$  to the temperature  $t_{a2} = 20^\circ\text{C}$  (Fig. 5). And the deficit of design boost refrigeration capacity  $Oq_{0.15d}$  for pre cooling ambient air to the temperature  $t_{a2} = 15^\circ\text{C}$  is also insignificant and it takes place only 3–4 days within 2–3 hours in July for climatic conditions in Nikolaev region (Fig.5). The results of analyses show that the heat load range for sub cooling the air from its intermediate temperature  $t_{a2} = 15^\circ\text{C}$  to the final temperature  $t_{a2} = 10^\circ\text{C}$  can be chosen as a stable basic design refrigeration capacity  $q_{0.10-15} = q_{0.10} - q_{0.15}$  (Fig. 2a) and a design boost refrigeration capacity for pre cooling ambient air from changeable current temperatures  $t_{amb}$  to the intermediate temperature  $t_{a2} = 15^\circ\text{C}$  is to be calculated by a remained principle as  $q_{0.10-15} = 34 - q_{0.10-15}$  (Fig. 3a) with total refrigeration capacity  $q_{0.10} = 34 \text{ kW}/(\text{kg/s})$ , providing the maximum annual refrigeration capacity output (Fig. 1).

### III. CONCLUSIONS

The optimum heat load on air conditioning system and corresponding designed refrigeration capacity providing the maximum annual refrigeration output, that is a maximum duration of refrigeration machine performance during a year, through a statistical treatment of data sets of hourly refrigeration outputs year round has been developed. A proposed approach is based on the hypothesis of sharing the total range of changeable current heat loads into a basic relatively stable part of heat load for air sub cooling from some intermediate temperature of pre cooled ambient air about  $t_{a2} = 15^\circ\text{C}$  down the any final temperature of cooled air, for example  $t_{a2} = 10^\circ\text{C}$ , which is covered with high energy efficiency due to the operation of refrigeration machine in the nominal mode, and the boost part of heat load for pre cooling ambient air to the intermediate temperature of about  $t_{a2} = 15^\circ\text{C}$  with less efficient operation of refrigeration machine at partial loads.

A proposed statistical approach provides improving the performance of air conditioning system due to matching the current site changeable climatic conditions.

### REFERENCES

- [1] Radchenko N. A concept of the design and operation of heat exchangers with change of phase. *Archives of Thermodynamics*: Polish Academy of Sciences, Vol.25, No.4 (2004), pp.3–19.
- [2] Bohdal T., Sikora M., Widomska K., Radchenko A. M. Investigation of flow structures during HFE-7100 refrigerant condensation. *Archives*

*of thermodynamics*: Polish Academy of Sciences, Vol. 36, No. 4 (2015), pp.25–34.

- [3] GTI Integrated Energy System for Buildings. Modular System Prototype: Rouse G., Czachorski M., Bishop P., Patel J. *GTI Project report 15357/65118*: Gas Technology Institute (GTI), January 2006, 495p.
- [4] Marques R.P., Hacon D., Tessarollo A., Parise J.A.R. Thermodynamic analysis of trigeneration systems taking into account refrigeration, heating and electricity load demands. *Energy and Buildings*, Vol. 42 (2010), pp.2323–2330.
- [5] Ortiga Jordi, Bruno Joan Carles, Coronas Alberto Operational optimisation of a complex trigeneration system connected to a district heating and cooling network. *Applied Thermal Engineering*, Vol. 50 (2013), pp.1536–1542.
- [6] Radchenko N., Kantor S. The analysis of efficiency of gas turbine inlet air chilling by waste heat recovery chillers for varying climatic conditions. *Proceedings of the 15 International Symposium on Heat Transfer and Renewable Sources of Energy: HTRSE 2014*, Szczecin, Poland, 2014, pp.349–354.
- [7] Radchenko A. Method of thermo-hour potential of gas turbine inlet air chilling and designing of rational chillers for varying climatic conditions of performance. *Proceedings of the 15 International Symposium on Heat Transfer and Renewable Sources of Energy: HTRSE 2014*, Szczecin, Poland, 2014, pp.325–331.
- [8] Radchenko A., Radchenko R. Method of estimation of potential of water extraction during gas turbine inlet air chilling. *Proceedings of the 15 International Symposium on Heat Transfer and Renewable Sources of Energy: HTRSE 2014*, Szczecin, Poland, 2014, pp. 333–340.
- [9] Trushliakov E., Zongming Y. Crew Member Comfort and Indoor Atmosphere Quality in Living Compartments of Manned Underwater Station. *ICMT 2016*, 16–18 July 2016, Harbin.

#### AUTHORS



**Dhanavath Dharma.** He received M.TECH degree from JNTU, Hyderabad, India, in 2008 and currently working as an Assistant Professor at “**SWAMI RAMANANDA TIRTHA INSTITUTE OF SCIENCES & TECHNOLOGY**”, Ramananda Nagar, S.L.B.C (POST), Nalgonda District - 508004, India. Email id: [dharma.dhanavath@gmail.com](mailto:dharma.dhanavath@gmail.com)



**Sangepu Ganesh.** He received M.TECH degree from JNTU, KAKINADA, India, in 2018 and currently working as an Assistant Professor at “**SWAMI RAMANANDA TIRTHA INSTITUTE OF SCIENCES & TECHNOLOGY**”, Ramananda Nagar, S.L.B.C (POST), Nalgonda District - 508004, India. Email id: [ganeshmech329@gmail.com](mailto:ganeshmech329@gmail.com)





10.22214/IJRASET



45.98



IMPACT FACTOR:  
7.129



IMPACT FACTOR:  
7.429



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24\*7 Support on Whatsapp)