



# **iJRASET**

International Journal For Research in  
Applied Science and Engineering Technology



---

# **INTERNATIONAL JOURNAL FOR RESEARCH**

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

---

**Volume: 8**

**Issue: IV**

**Month of publication: April 2020**

**DOI:**

**[www.ijraset.com](http://www.ijraset.com)**

**Call:  08813907089**

**E-mail ID: [ijraset@gmail.com](mailto:ijraset@gmail.com)**

# Comparative Analysis and Design of Cooling Tower with STAAD-PRO and Manual Calculations

Shantanu G. Kitukle<sup>1</sup>, Prof. Bharati Changhode<sup>2</sup>

<sup>1</sup>P.G. Student, <sup>2</sup>Assistant Professor, Department of Civil Engineering, G. H. Rasoni University, Amravati, Maharashtra, India

**Abstract:** *The cooling tower is a device that transforms hot water into cold water through direct air contact. It runs on the temperature difference between the air inside the tower and outside the tower. The natural cooling Tower project is one of the most widely used cooling towers. The hyperbolic shape of the cooling tower is usually preferred due to its durability and stability and a large available area based on the shape. Since it is a very important structure in atomic and chemical plants, it should be continuously assessed for its stability under its own weight, and lateral loads like wind load and E. Rthquake load. For this, cooling towers were tests for the wind load, suggesting that the fixity-based shell. Wind loads on these cooling towers were designed as pressure using distributed design of Wind pressu Re coefficients, as is given: 11504-1985 code along with wind pressure design on various. The present study deals with the analysis of cooling tower maximum displacement, support reactions, support moments, stresses and bending moments in plates due to seismic loading, wind loading and dead load i.e. its self weight on a hyperbolic cooling tower is continuous function of geometry.*

**Keywords:** *Cooling Tower, wind load, stresses and moments*

## I. INTRODUCTION

The cooling tower is a thermal device failure that pulls out heat waste from the water stream into the atmosphere and cools the water to the lower temperature. It is difficult to design and analyze the structure for the forces, as it is the structure of the shell. The quake and wind loads are two important parameters that should be dealt with, making things more complex. There have been many attempts to formulate methods of design and analysis for the cooling tower and many model studies have also occurred even from very early times. The cooling tower is a thermal device failure that pulls out heat waste from the water stream into the atmosphere and cools the water to the lower temperature. It is difficult to design and analyze the structure for the forces, as it is the structure of the shell. The quake and wind loads are two important parameters that should be dealt with, making things more complex. There have been many attempts to formulate methods of design and analysis for the cooling tower and many model studies have also occurred even from very early times.

## II. REVIEW OF LITERATURE

The cooling tower's reaction is governed by both vertical and circumferential wind distribution. The ultimate bearing capacity of the cooling tower housing is obtained by 1.925 times, that of the construction of wind pressure, corresponding to wind speed of 40.2 m/s (90 mph). Nonlinear behaviour began due to formation of cracks of horizontal tensions in Meridian Meridian by 43% The height of the cooling Tower Corps. A free vibration analysis method may be used in seismic analysis using violent needs of the seismic design of the NDKT. The stress state in the cooling tower occupies a full range of F ro m tension in the domain compression. When the height increases, wind vibration coefficients increase first, then decrease and reach the maximum at the top of the(Parth.R.Chhaya et al 2014).

This document considers the study of thermal analysis of cooling towers. In the case of research of the cooling towers from Bellary thermal Power plant (BTES) are selected. These cooling towers are analyzed using software staffs. ProV8i, assuming top-end free and fixity-based. The material properties of the cooling towers are included in the young Mpa module, the Poisson coefficient 0.15 and the density of 25kN/m<sup>3</sup>. The results of the analysis are obtained: displacement in X, Y, Z directions and maximum main stress. Variations on the thickness of V/s, Max's main stress v/s thickness built graphically. The rate of heat loss depends on the atmospheric parameters such as air temperature, water temperature, relative humidity and the rate of heat loss. Due to the thermal imaging, the displacement at the top of the cooling tower in the direction of X and Z goes to increase with a decrease in thickness and height. Due to the thermal imager, the shift towards Y goes to increase (Priya Kulkarni et al, 2015).

The study is engaged in a modal analysis of the hyperbolic cooling towers. Two existing cooling towers are selected from Bellary Thermal Power Plant (BTPS) as a case study. The analysis uses the software based on FOREIGN trade. Marginal conditions conside Red upper end free and lower end fixed.

The material properties of the cooling tower are the module young 31Gpa, the Poisson coefficient 0.15 and the density of RCC 25 Kn/m3. The performed analysis is carried out by means of 8-foot body of 93 element. Natural frequencies, maximum number, maximum load, voltage, max voltage background, do not get the load. Variations of the Max main stress v/s thickness, the maximum deviation of V/s thickness is built graphically (Sachin Ku Lkarni et al., 2014).

### III. MODELING

The modeling is carried out for the plate thickness of 0.25, 0.3, 0.4 & 0.5 (with and without Earthquake Loading). The analysis carried out in STAAD-PRO as follows

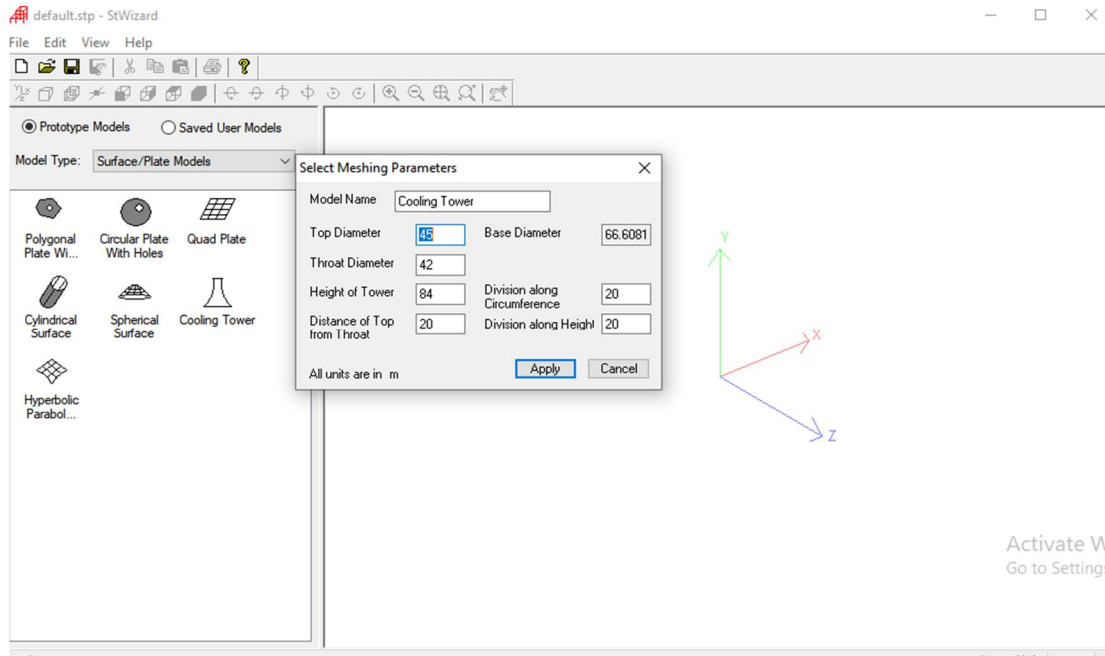


Fig.1: Properties considered for Cooling Tower

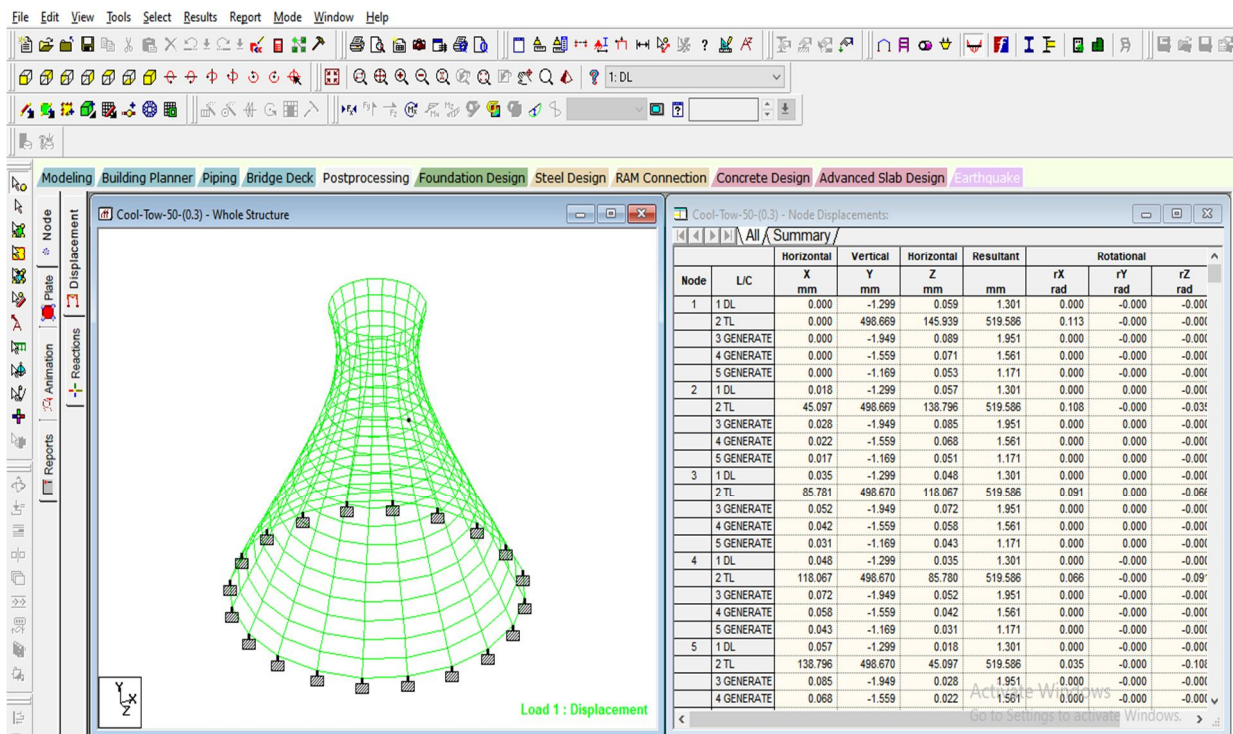


Fig 2. Modeling of Cooling Tower

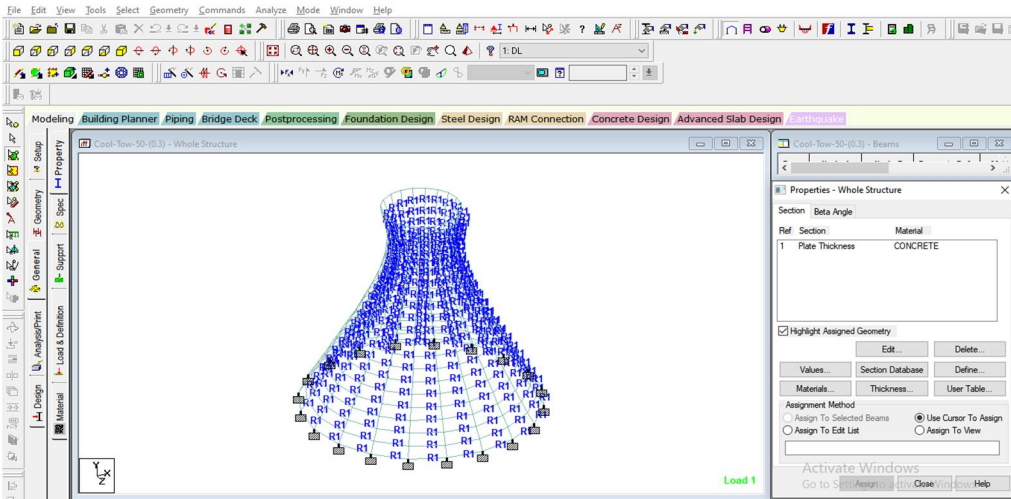


Fig.3: Assigning properties to Cooling Tower


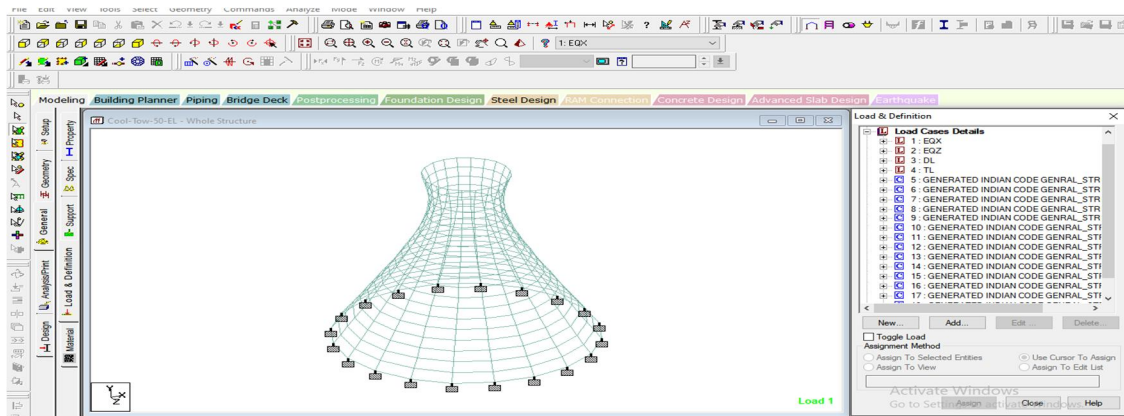


Fig.4: Assigning load to Cooling Tower

The analysis of the cooling tower models are completed using Indian standard code and accordingly the results are obtained

#### IV. RESULTS

The results for the cooling tower models are mentioned as follows:

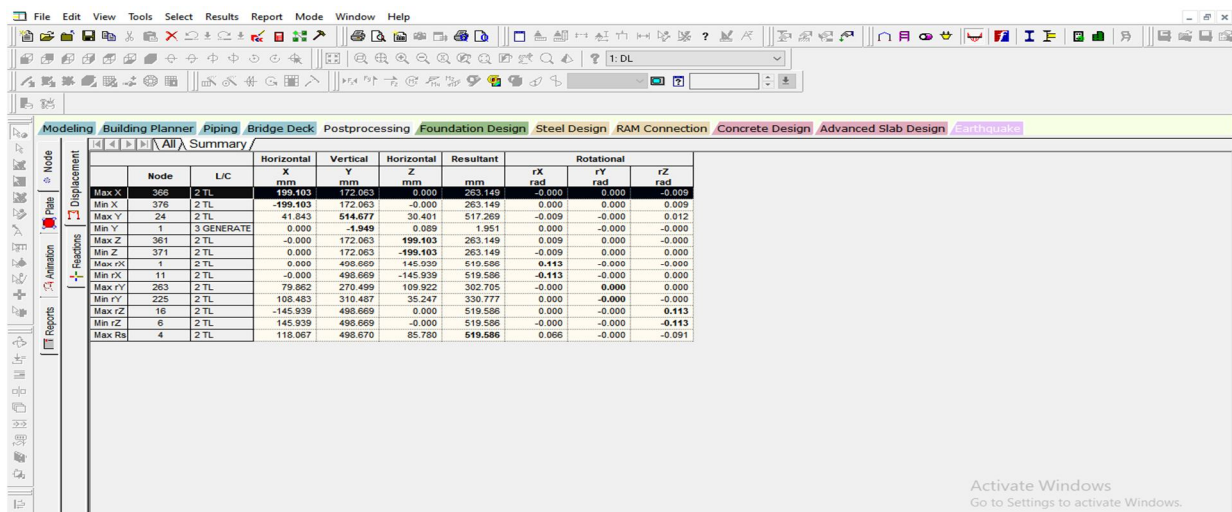

Node	L/C	Horizontal			Resultant	Rotational			
		X mm	Y mm	Z mm		rX rads	rY rads	rZ rads	
Max X	366	2 TL	199.103	172.063	0.000	263.149	-0.000	0.000	-0.009
Min X	376	2 TL	-199.103	172.063	-0.000	263.149	0.000	0.000	0.009
Max Y	24	2 TL	-41.843	514.677	30.401	517.269	-0.009	-0.000	0.012
Min Y	1	3 GENERATE	0.000	-1.949	0.089	1.951	0.000	-0.000	-0.000
Max Z	361	2 TL	-0.000	172.063	199.103	263.149	0.009	0.000	-0.000
Min Z	371	2 TL	0.000	172.063	-199.103	263.149	-0.009	0.000	0.000
Max rX	1	2 TL	0.000	498.669	145.939	519.586	0.113	-0.000	-0.000
Min rX	11	2 TL	-0.000	498.669	-145.939	519.586	-0.113	-0.000	0.000
Max rY	263	2 TL	79.862	270.499	109.922	302.705	-0.000	0.000	0.000
Min rY	225	2 TL	108.463	310.467	35.247	330.777	0.000	-0.000	-0.000
Max rZ	16	2 TL	-145.939	498.669	0.000	519.586	0.000	-0.000	0.113
Min rZ	6	2 TL	145.939	498.669	-0.000	519.586	-0.000	-0.000	-0.113
Max Rn	4	2 TL	118.067	498.670	85.780	519.586	0.066	-0.000	-0.091

Fig.5: Results in STAAD-PRO

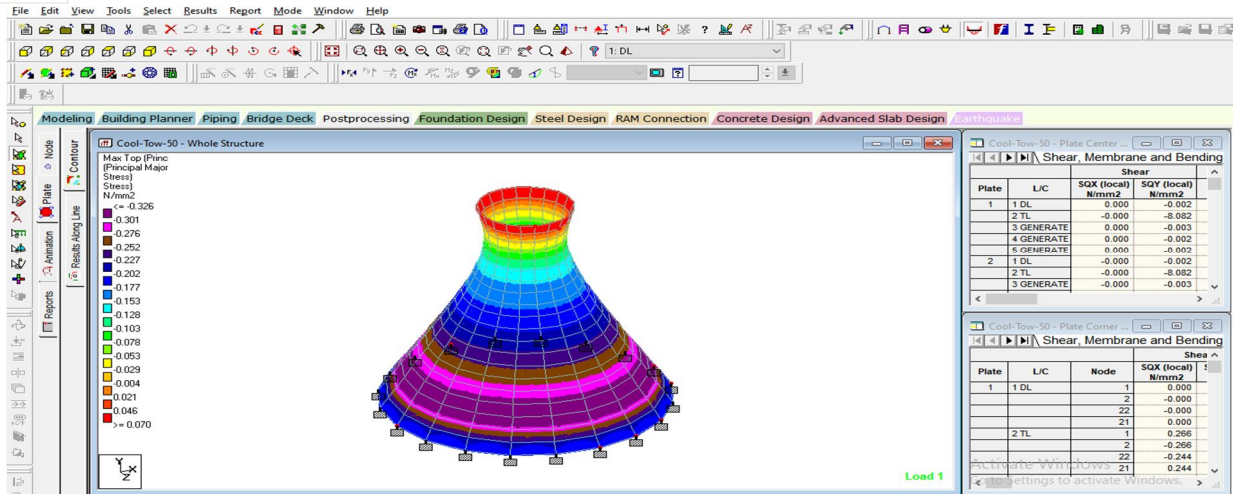


Fig.6: Principal Major Stress(N/mm<sup>2</sup>)

Table 1: Plate bending analysis

	Plate	L/C	Shear		Membrane			Bending Moment	
			SQX (local) N/mm2	SQY (local) N/mm2	SX (local) N/mm2	SY (local) N/mm2	SXY (local) N/mm2	Mx kNm/m	My kNm/m
Max Qx	381	2 TL	0	9.624	-145.515	-5.653	0	-12477.301	-8871.974
Min Qx	382	2 TL	0	9.624	-145.513	-5.65	-0.001	-12477.308	-8871.974
Max Qy	384	2 TL	0	9.624	-145.514	-5.654	0.001	-12477.31	-8871.985
Min Qy	3	2 TL	0	-8.082	21.11	-2.81	0	-11321.005	-4693.195
Max Sx	3	2 TL	0	-8.082	21.11	-2.81	0	-11321.005	-4693.195
Min Sx	381	2 TL	0	9.624	-145.515	-5.653	0	-12477.301	-8871.974
Max Sy	341	2 TL	0	-1.182	1.422	0.712	0	-13426.519	-14767.958
Min Sy	384	2 TL	0	9.624	-145.514	-5.654	0.001	-12477.31	-8871.985
Max Sxy	384	2 TL	0	9.624	-145.514	-5.654	0.001	-12477.31	-8871.985
Min Sxy	382	2 TL	0	9.624	-145.513	-5.65	-0.001	-12477.308	-8871.974
Max Mx	363	3 GENERATED INDIAN CODE GENERAL STRUCTURES 1	0	-0.005	-0.427	-1.141	0	1.336	5.568
Min Mx	362	2 TL	0	0.82	-49.687	-0.424	0	-13697.573	-15676.215
Max My	361	3 GENERATED INDIAN CODE GENERAL STRUCTURES 1	0	-0.005	-0.427	-1.141	0	1.336	5.569
Min My	365	2 TL	0	0.82	-49.687	-0.424	0	-13697.563	-15676.234
Max Mxy	145	2 TL	0	0	0	0	0	-13083.428	-13083.36
Min Mxy	325	2 TL	0	-0.584	7.542	0.337	0	-13125.606	-13351.221

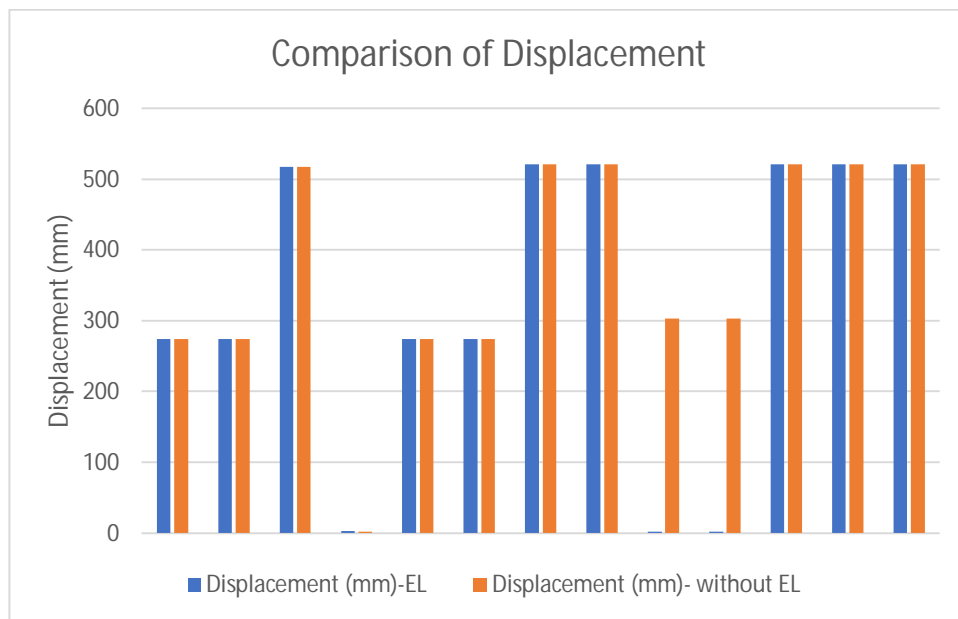


Fig.7: Comparison of Displacement for Cooling Tower with and without Earthquake load (EL)

Table 2: Stresses in plate of Cooling Tower  
Cooling tower-50 ( EL)

			Principal		Von Mis		Tresca	
	Plate	L/C	Top N/mm2	Bottom N/mm2	Top N/mm2	Bottom N/mm2	Top N/mm2	Bottom N/mm2
Max Principal (top)	6	11 GENERATED INDIAN CODE GENERAL_STRUCTURES 7	0.197	0.152	0.178	0.266	0.197	0.308
Min Principal (top)	381	4 TL	-444.97	153.941	385.375	186.42	444.97	207.275
Max Principal (bottom)	361	4 TL	-376.654	375.805	377.543	337.981	378.426	375.805
Min Principal (bottom)	366	11 GENERATED INDIAN CODE GENERAL_STRUCTURES 7	-1.21	-1.464	1.066	1.295	1.21	1.464
Max Von Mis (Top)	381	4 TL	-218.58	207.275	385.375	186.42	444.97	207.275
Min Von Mis (top)	16	7 GENERATED INDIAN CODE GENERAL_STRUCTURES 3	-0.017	-0.058	0.025	0.057	0.029	0.058
Max Von Mis (Bottom)	341	4 TL	-320.814	355.143	338.468	340.494	353.719	355.143
Min Von Mis (bottom)	10	1 EQX	-0.018	-0.015	0.042	0.028	0.048	0.033
Max Tresca (top)	381	4 TL	-218.58	207.275	385.375	186.42	444.97	207.275
Min Tresca (top)	16	7 GENERATED INDIAN CODE GENERAL_STRUCTURES 3	-0.017	-0.058	0.025	0.057	0.029	0.058
Max Tresca (bottom)	361	4 TL	-376.654	375.805	377.543	337.981	378.426	375.805
Min Tresca (bottom)	10	1 EQX	-0.018	-0.015	0.042	0.028	0.048	0.033



## V. CONCLUSION

From the above study following conclusions can be drawn:

- A. Principal stresses, Von Mis stresses are maximum in cooling tower considering with Earthquake analysis
- B. Top combined stress and bottom combined stresses are found to be more in case of cooling tower without EL.
- C. Displacement is maximum as the height goes on increasing
- D. Reactions found to be more in case of more height of cooling tower

## REFERENCES

- [1] Parth.R.Chhaya, Nizam.M.Mistry and Anuj.K.Chandiwala, "A Review On Effect Of Wind Loading On Natural Draught Hyperbolic Cooling Tower", International Journal of Advance Engineering and Research Development, Volume 1, Issue 12, December -2014.
- [2] Priya Kulkarni and S. K. Kulkarni, "Thermal Effect on RCC Hyperbolic Cooling Tower", International Journal of Innovative Research in Science, Engineering and Technology, Vol. 4, Issue 9, September 2015.
- [3] Sachin Kulkarni and Prof A.V. Kulkarni, "Modal Analysis Of Reinforced Concrete Cooling Towers", International Journal of Advance Engineering and Research Development, Volume 1, Issue 12, December -2014.
- [4] Iqbal Hafeez Khan, Rakesh Patel and Aslam Hussain, "Parametric Analysis Of Hyperbolic Cooling Tower Under Seismic Loads Through Staad.Pro", International Research Journal of Engineering and Technology (IRJET), Volume: 02 Issue: 09 | Dec-2015.
- [5] Pujaa Venkataiah and P. Prakash, "Seismic Analysis and Design of a Hyperbolic Cooling Tower", International journal of scientific engineering and technology research, Vol.05, Issue.12, May-2016, Pages:2413-2415.
- [6] Akash Goyal, A N Shankar and S K Sethy, "Parametric Analysis of Hyperbolic Cooling Tower under Seismic Loads, Wind Loads and Dead Load through Staad. Pro", International Journal of Engineering Research & Science (IJOER), Vol-3, Issue-8, August- 2017.
- [7] Athira C R, Rahul K R, Reshma R Sivan, Seethu vijayan and Nithin V Sabu, "Linear and Nonlinear Performance Evaluation and Design of Cooling Tower at Dahej", IOSR Journal of Mechanical and Civil Engineering (IOSR -JMCE), International Conference on Emerging Trends in Engineering & Management.
- [8] R. Purusothaman, "Planning, Designing And Analysing Of Cooling Tower", International Journal of Advanced Research in Civil, Structural, Environmental and Infrastructure Engineering and Developing, Volume: 3, Issue: 1, Special Issue: 1, Mar, 2018.
- [9] Dr. S. N. Tande and Snehal S. Chougule, "Linear and Nonlinear Behaviour of R. C. Cooling Tower under Earthquake Loading", International Journal of Latest Trends in Engineering and Technology, 2(4), 2013, 370-379.
- [10] Shailesh S. Angalekar and Dr. A. B. Kulkarni, "Analysis of Natural Draught Hyperbolic Cooling Towers by Finite Element Method Using Equivalent Plate Concept", International Journal of Research and Applications, 1(2), 144-148



10.22214/IJRASET



45.98



IMPACT FACTOR:  
7.129



IMPACT FACTOR:  
7.429



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24\*7 Support on Whatsapp)