



iJRASET

International Journal For Research in
Applied Science and Engineering Technology



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Volume: 8 Issue: VIII Month of publication: August 2020

DOI: <https://doi.org/10.22214/ijraset.2020.31080>

www.ijraset.com

Call:  08813907089

E-mail ID: ijraset@gmail.com

Power Grid Voltage Modified Direct Power Control (DPC) for a Weak Grid Connected to Voltage Source Inverter (VSI) and Stability Analysis

Ishteyaque Zafar¹, A. Thakur²

^{1,2}School of engineering SSSUTMS, Sehore

Abstract: This paper shows the Dual Voltage Source Inverter (DVSI) system to improve the power quality and reliability of a small grid system. The proposed scheme is made up of two inverters, which enable a small grid to be able to exchange the type of power measured by the Distributed Energy Resources (DER) and compensate for the empty internal load. Control algorithms are developed based on the Instantaneous Symmetrical component Theory (ISCT) using DVSI in grid sharing and grid injection methods. The proposed scheme has increased reliability, lower bandwidth demand for the main inverter, lower costs due to reduced filtering size, and better use of less energy while using reduced DC-link gas power for the main inverter. These features make the DVSI system a promising grid option for minimal critical provision. Also in this paper, we design a modified direct voltage control (VM-DPC) for phase-to-phase voltage (VSI) connected to a weak grid, where the PLL system can make the system unstable if the normal vector current control (VCC) method is used. Compared to the traditional VCC method, the main advantage of the proposed VM-DPC approach is that the PLL system is completed. PLL Used for grid synchronization In addition, in order to incorporate true measurement power into a weak grid, the VSI system must generate a certain amount of active power as well. Eigenvalues-based analyzes show the system through a proposed process that traces its required strengths to a specific performance level. Note that the required power rating of the SVR is very low (say 2.7%) compared to the load count given the 5% voltage rule. In this function, the power controller is connected to the center of the grid, but can be connected to other locations to obtain the exact same measurement. Proposed adjustments are made to MATLAB / SIMULINK. Both the effects of simulation and magic are in line with the theoretical expectations for intimacy. ALSO rating reduction has been improved.

Highlights: VM-DPC, DC-DC directional converter, source Voltage (VSC) converter, band pass filter

I. INTRODUCTION

In the current context technological advancement and environmental concerns lead to a system of power change in general with renewable energy sources connected to the network for generations to be distributed (DG). These DG units have the following generation generation controls and storage areas from a small grid. In a small grid, power from uninterruptible power sources such as fuel cells, photovoltaic systems (PV), and wind power systems are connected to grid and loads with electrical converters. The inverted grid inverter plays a major role in converting electrical power converters. The grid connected to the inverter plays a major role in exchanging power from a small grid to the grid and the connected load. This small grid inverter can work in grid sharing mode while moving part of the local load or in the grid injection mode, by inserting power into the main grid. Energy quality adjustment is another major factor to be considered when a large grid is connected to a small grid system. The proliferation of electronic and power devices and power loads with uneven nonlinear currents has impaired the quality of power in the power distribution network. In addition, when there is a large number of feeder interference in the distribution network, the distribution of these hazardous storms distorts the voltage in the common junction (PCC). On the other hand, industrial automation has reached a higher level of research; on the other hand plants such as automotive construction, chemical factories, and semiconductor production facilities require clean energy. By working for these services, it is necessary to compensate for unequal and uneven load loads.

Load compensation and power injection are made by grid inverters that go into the small grid provided in the books. A single inverter system with a high-power device is discussed. The main focus of this work is to understand the dual functionality of the inverter which will provide an amative power injection from the solar PV system and also works as an effective power filter, compensating for the imbalance and the active energy required for other loads connected to the system. In, a power and energy efficiency (WES) system is proposed. The static compensator (D STSTCOM) supplier is used not only for voltage regulation but also for effective power injection.

This control scheme controls the power balance in the grid storage area with air fluctuations with slide mode controls. An electronic dictionary of electrical energy used in DG electricity is defined. Most of the literature reviewed here in this area discusses topologies and power management compensation algorithms in the same inverter in addition to their active power injection. When a grid-connected inverter is used for two active power and compensation injections, the amount of inverter that can be used to achieve the previous purpose is determined by the available power of the fast power grid. Considering the case of grid-connected PV inverter, the available inverter power supply is small during periods of high solar installation. At the same time, effective PCC voltage control is much needed during this time. It shows that providing multiple performance in a single injector undermines the power or real power injection or reload capacity. This paper shows a dual-voltage power source (DVSI) system, in which the power of a small grid is fed as true power by a large voltage source inverter (MVSI) and the active, harmonic, and unequal load compensation is generated by voltage assisted source inverter (AVSI). Voltage source converters (VSC) are extensively used in smart grids in modern power grids, flexible AC drive systems, or renewable energy sources (such as wind and solar). One of key strategies in VSC is the grid connected voltage source inverter (VSI), which is generally controlled as a current source injecting current into grid. For network connected VSI, conventional vector current control strategies are generally used to afford acceptable control performance. However, the network related VSI using normal vector current control strategy is reported to be weak and having stability and performance issues. Furthermore, the penetration of renewable energy sources into modern power grids continues to increase, the maintenance of stability or high control excellence providing by the grid-connected VSI becomes increasingly important. An extensively used VSI control system is current control, where a phase locked loop (PLL) is used for network synchronization. In new years, adverse effect of PLL on the stability of the small VSI signal has been stated. It has been found that by presenting negative incremental conformation at low incidences, the PLL can reduce stability of VSI. The VSI frequency coupling dynamics presented by PLL has also been clearly revealed. The incidence variety of negative resistance is resolved by bandwidth of PLL. Therefore, a low bandwidth PLL is generally used to improve VSI stability, which seriously impairs the dynamic performance of the system. Furthermore, even if PLL is intended to have very low bandwidth, VSI is still problematic to maintain stability in extremely weak network conditions, in this case the network impedance is close to 1: 3 pu. [2][3] Wang recently short harmonic constancy caused by grid-connected VSI in current power grids, where small VSI signal dynamics tend to present negative checking, which can be in changed frequency ranges, depending on the two controls on the Inverter Device. Converter or power scheme situations. Therefore, to ensure stable VSI operation under weak network conditions, a PLL-free control strategy is required. Another control method, Direct Power Control (DPC), has been studied for network connected VSI to directly control prompt active power and reactive power without using an internal loop present regulator or PLL system. However, the main disadvantage of these methods is the adjustable switching frequency based on the switching state, which can lead to an unexpected wideband harmonic spectrum, i.e. it is not easy to project a line filter correctly. To achieve a constant switching incidence, many DPC strategies have been future. Some of them use spatial vector inflection or calculate required converter voltage vector in each switching cycle[4][19]. In addition, taking robustness into account, slider mode control is applied to DPC method to ensure fast chasing presentation of active or sensitive power, and taking into account the inherent dissipation of the system, passive DPC-based control is proposed. Though, there are still uninvited fluctuations in active power or responsive power.

One of best regulator algorithms, Model Predictive Control (MPC) -DPC, is designed intuitively bearing in mind multivariate conditions, nonlinearity, and system constraints. In each sampling period, MPC-DPC selects a sequence of voltage vectors or computes duty cycle. MPC-DPC also affords a constant converting frequency. However, this can cause an additional computational burden. Recently, Gui et al. Presented DPC network voltage modulation (GVM-DPC), which solves the main downside of the DPC technique, i.e. steady state presentation[17] The linear invariant time system (LTI) is obtained through the distribution generator (DG) based on the importance of photovoltaic (PV) energy based on GVM-DP (PV) and its integration. VSI designs and analyzes the system.

This chapter will present the challenges facing microgrid applications. DG and micro grid will be discussed in detail. Through an adequate bibliographic survey, the process of the passive distribution network to its active technical state is discussed. The gap in the literature comes from the existing technical and economic benefits and challenges. Since the microgrid can operate in standalone interactive mode with the network, detection of these modes has been emphasized in the scope of current research. PV focuses on DG-based integration. Here we discuss the latest developments in PV (existing literature), PV integration via voltage source converters (VSC), and grid synchronization. This article discusses the importance of distributed PV based generation in current and future Indian power scenarios. Since the damping curve of the photovoltaic system is small, the main objective is to improve the stability of independent DG controller. [5][6]

II. RELATED WORK

The power to switch to renewable input is to vary the power output in the dispersed areas, so the Pulse Width Modulation (PWM) power source (VSI) becomes the most frequently used boundary between renewable resources or power grid. The endless grid connected to the VSI has become the main alarm for electrical engineers. Numerous studies have shown that the accumulation of network connected to the VSI is influenced by the controller or filter filters. In addition to filters or control parameters, a weak power grid will also disrupt the presence of a VSI connected network. circuit lattice (SCR), i.e., high impedance or low continuous inertia (H), which is a common microgrid factor. As a result, power or frequency will be loaded into the hard grid. Alternatively, if the power in the switching area (PCC) typical has characteristics corresponding to the natural size of the LCL filter. VSI connected network can be bad. If a voltage transmission method is used to reduce the response time of a closed circuit scheme, the situation will become more difficult. [10] [11] [13] Equally, the control jet assembly method can make the system less confident in a machine with current harmonics. Therefore, continuous inverter testing on a weak current network is a complex complex that requires a dynamic model. Root locus state planetary or Nyquist impedance based strategies defined in the VSI-linked grid strength test. The support systems used use equal circuits, so it is not possible to simply research the outcome of each cycle and control parameters for system robustness. [14] [8] In a dynamic analysis of a VSI-connected network in the form of a state-of-the-art environment, an abridged model is usually measured by a system (cycle) or controller. If you need to investigate the effects of simultaneous changes in the cycle and control parameters, this in vulgarization makes constancy a whole system difficult to analyze. [9] [10]

III. PROPOSED SYSTEM

A standard DC microgrid standard setup, where most power bases are assembled with bus 0 and loads are associated with non-standard buses. This system is widely used due to its simplicity and cost-effectiveness [1]. And, in this fix, the development of the loading leg is easy. Changes in the volume of the main loaded bus, described in the first section. The bus capacity away from the load (such as buses 3 and 4 here) may drop below the limit due to the load. The recommended SVR should be accompanied by a suitable storage area for all voltages within a 5% deviation. The SVR input side is connected to the network using channels A and B. The output side is connected in the network sequence (between bus 2 and bus 3). Depending on the connection, the SVR output will withstand the low voltage (V_{svro}) associated with the line drop or will withstand up to the nominal line (I_{svro}), while the SVR input will counteract the low and low DC mains voltage (V_1) current. (I_{in}) In this work, a new approach is proposed to ensure that when the active force of a load changes suddenly, there is sufficient supply of line and phase to achieve stable performance. The main contributions to this project are:

- A. Accurate AC grid dynamic model with direct electrically directed power Control (VM-DPC) by eliminating PLL.
- B. AC grid analysis control with damping ratio of Band Pass Filter (BPF) variance.
- C. A Third-Phase Venture Engine (VSI) used to convert DC to AC from a DC connector to an AC grid.
- D. The voltage synchronization in Gird connected load by controlling the VSI using the VM-DPC process.
- E. A BAND PASS filter is introduced that provides power supply to the VM-DPC input source

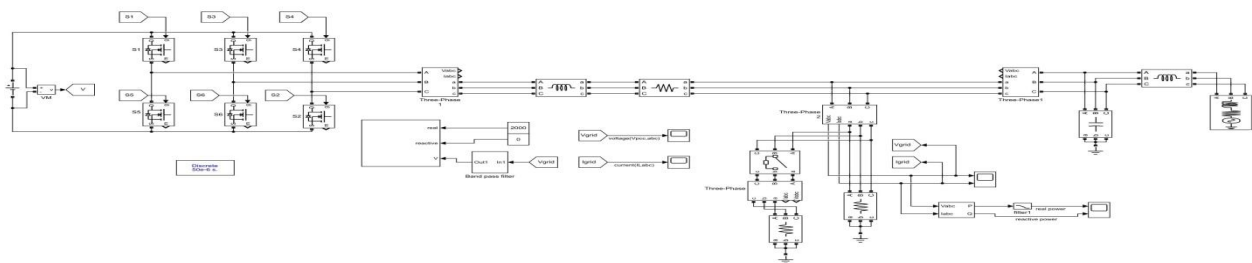


Fig.1 Proposed Simulink model

1) *Topology*: The recommended SVR topology is shown in Figure 1. The SVR consists of a DAB and a full DC-DC converter. Two jumpers (lower and second) in the DAB are used to produce high frequency wave events at the conversion points. The phase shift between the two triangular waves may be related to the control flow from V1 to V2 and vice versa. The constant flow of energy flowing from the bridge produces a large tetragonal wave to another bridge [20]. Please note that DAB operates in power control mode. When the output current (I_{inb}) and input voltage (V_1) change, the DAB output voltage (V_2) retains its reference value. The constant output power of the DAB comes with the installation of a full DC-DC converter. The full bridge operates in electric power mode with unipolar infipction [21] to produce flexible DC (V_{svro}) gas power. Therefore, under stable and temporary conditions, the amount of power bond in the appropriate division can also be repeated with the DC network. In this scheduled system, SVR controls the power of bus 3 by adding the volume of the controlled series and the appropriate separation. One of the most important features in the VSC is the grid-related grid power source (VSI), which is often rated as the current damage to the grid. With network-enabled VSI, standard vector control techniques are used to deliver an acceptable control presentation. However, network-related VSI using a standard vector control strategy is currently described as weak and has problems with durability and performance. The proposed system includes two control modules to ensure that the bus voltage 3 is within the limits of the conditions under modified load conditions. Block I controls the flow of energy or maintains a constant voltage at the outlet of the DAB. Module II shows the control of a full DC-DC converter operating in power control mode. Voltage Control Figure 4 shows the full DC-DC converter control to control the output power of the SVR (V_{svro}). A low voltage voltage (up to bus 3) was used to refer to the controller. The gas power of the reference is generated by the following formula.

$$V * svro = V * grid - V_1$$

Error formed between position and actual exit voltage (i.e. $V * svro - V_{svro}$) given to the PI control.

The PI controller provides a control signal (e.g., V_c) to produce PWM signals for T9 to T12 switch. The PI control detection option should reduce the voltage of the voltage circuit less than 10 times rather than change the events

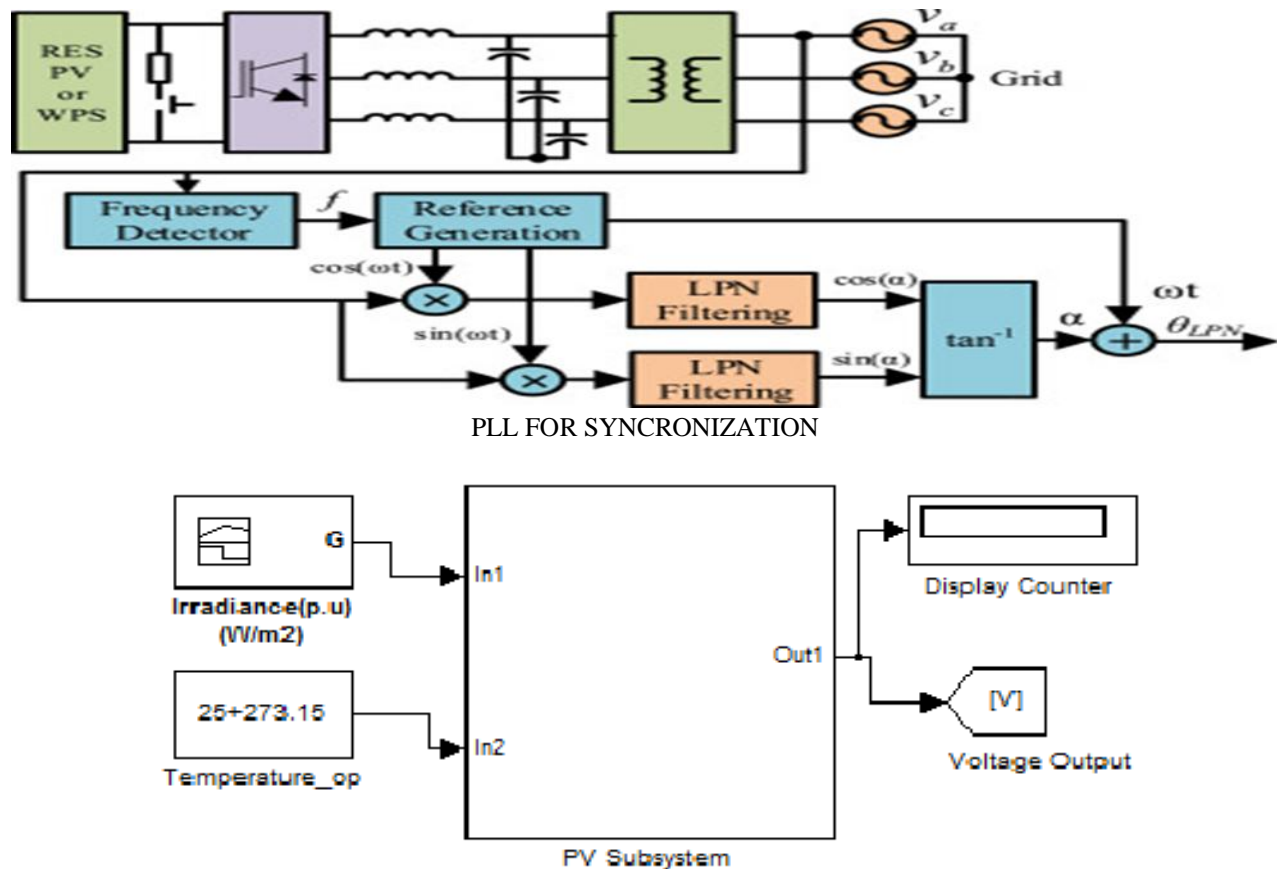


Fig. 4 Solar Sub System

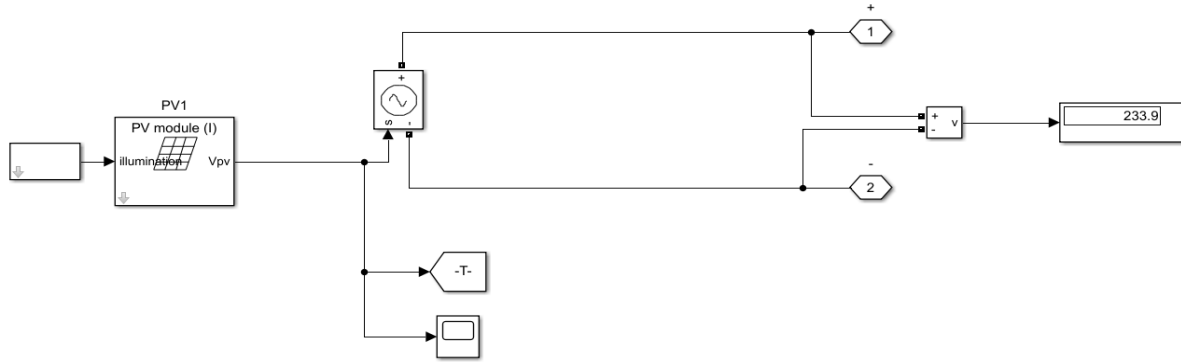


Fig.5 PV Panel Sub System

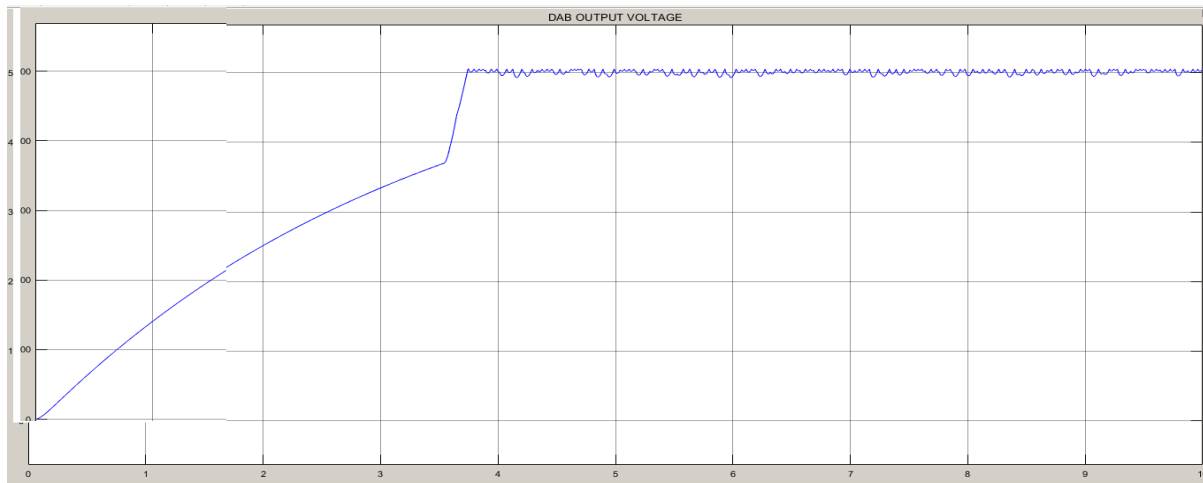


Fig 6 DAB Output Voltage

Therefore, it is possible to control the flow of energy forward and backward during brownout and brownout, respectively. The conduction of the switching device in DAB occurs at zero power, which reduces the transmission loss of the converter. The SVR can automatically convert microgrid bus gases to a variety of loading conditions.

The SVR response time between the transients is determined by the power controller (e.g. the second phase of the control circuit) or the capacitor associated with the SVR output. Here, the SVR adds the appropriate series power with the appropriate schism to compensate for the voltage drop athwart the resistor line. Figure 9 (c) and (d) show the SVR input and output voltage, respectively. Also note the DAB output voltage

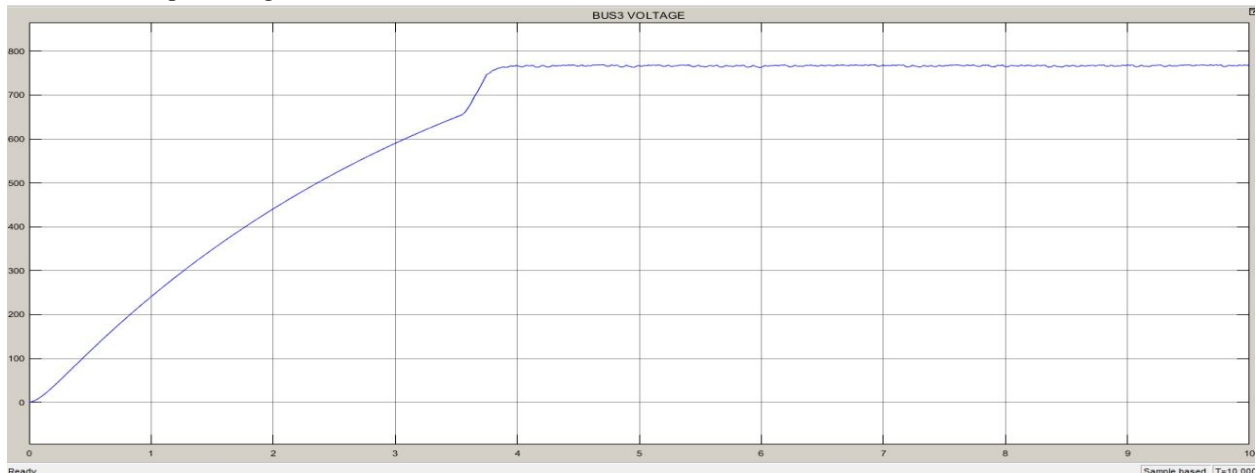


Fig8 . Bus Voltage

The power of the DC bus is related to the high power of the network input. To look at: DC bus capacity is approximately $\sim 1,414 \times$ RMS voltage. The complete import of bus and iyivi buses is the current pass from the bus to the ground. Where VR is the reference voltage vector $(n-1) \times 1$ three-dimensional containing the renewable bus volume on each object.

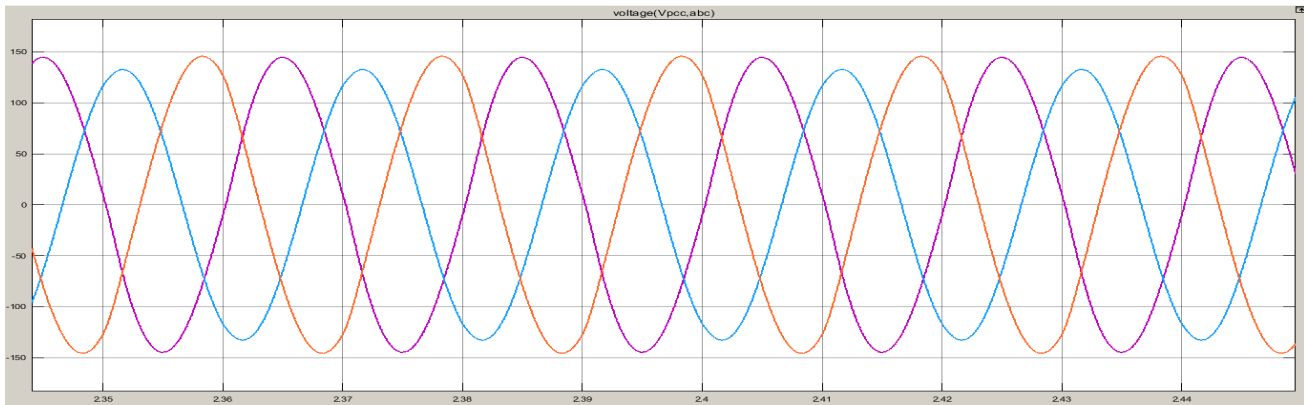


Figure 9 show the solar power output curve and daily load when a constant amount of energy is received from the public power system. The constant power circuit works by calculating the voltage across the load and the current drawn. The charging power limit curve representing the current and voltage amplitude of the charging current within a certain range, the charging circuit can be operated safely Fig 9 Constant Power

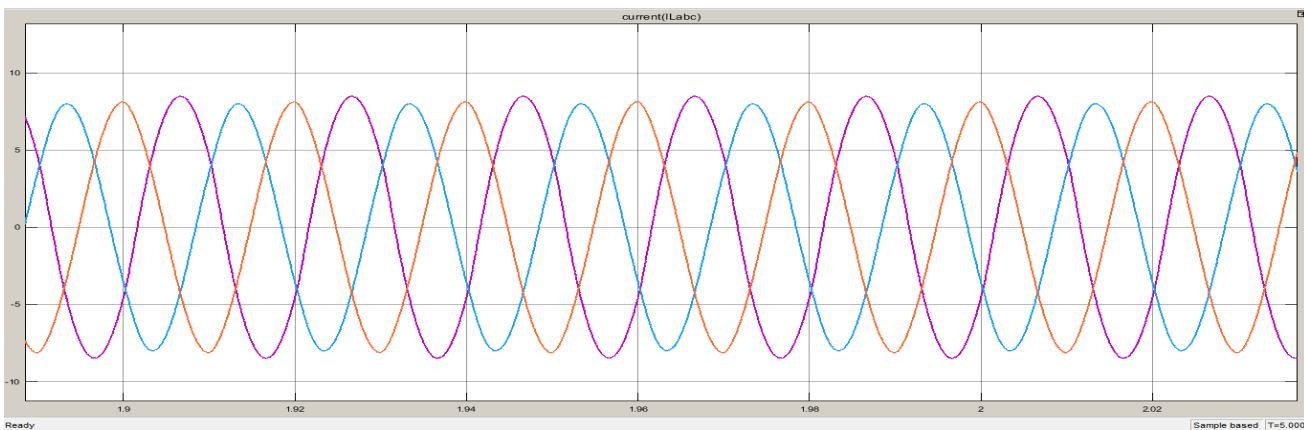


Fig10 Voltage ($V_{pcc, abc}$) Current ($I_{L, abc}$)

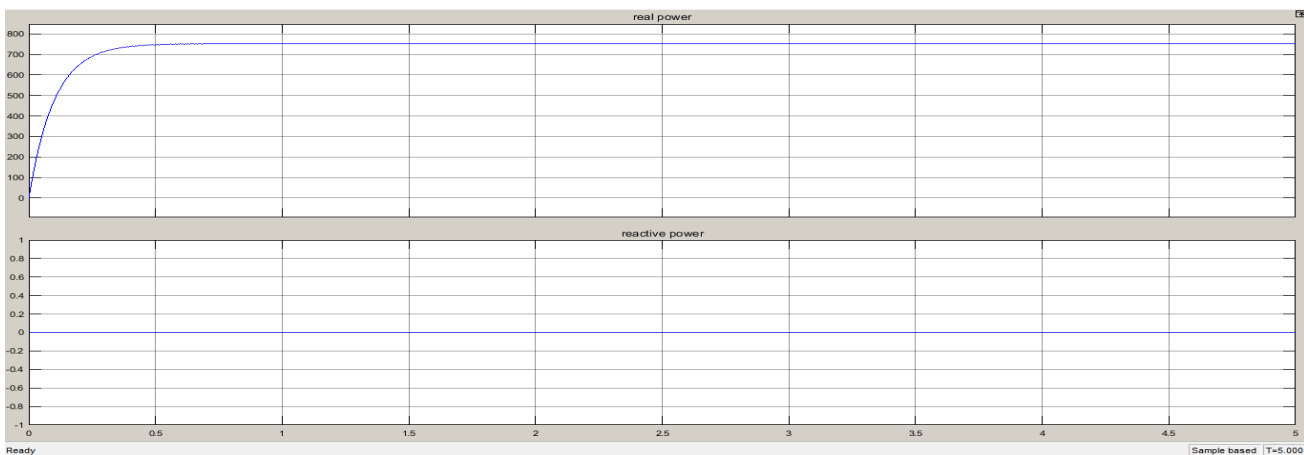


Fig 11 Real And Reactive Power (P,Q) Vary Power AT 2.5 Second

In addition, at 0.8 s, when VSI controls the active power of 3: 5 kW and the active power of 2: 0 kvar, the variable load connects to the PCC or uses 1.0 kW of active power, as shown in Figure 13. When VSI converts active power or reaction power to 0: 5 kW and 2: 0 kvar, separately, the function of the proposed control system

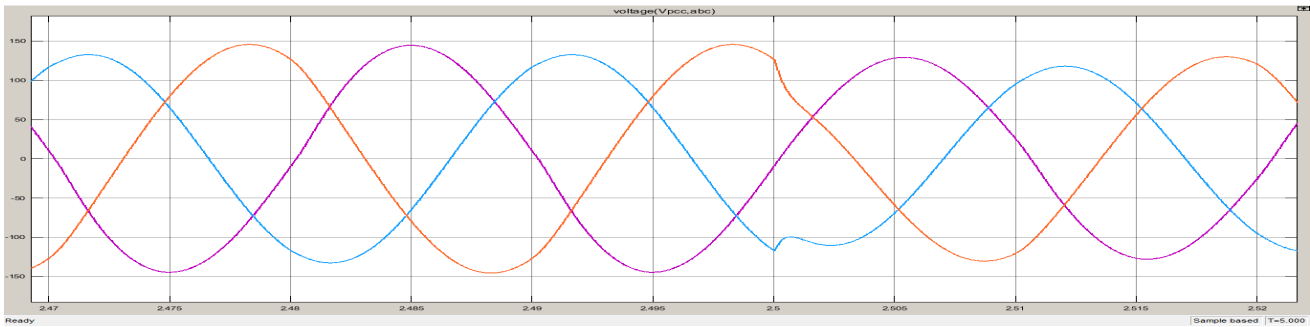


Fig .12Voltage($V_{pcc, abc}$)

The current strength characteristics vary according to the voltage levels in the V_{abcc} relative to the I_{abc} . Therefore, the required dynamic features should be selected in order to determine the suitable DC microgrid operating environment.

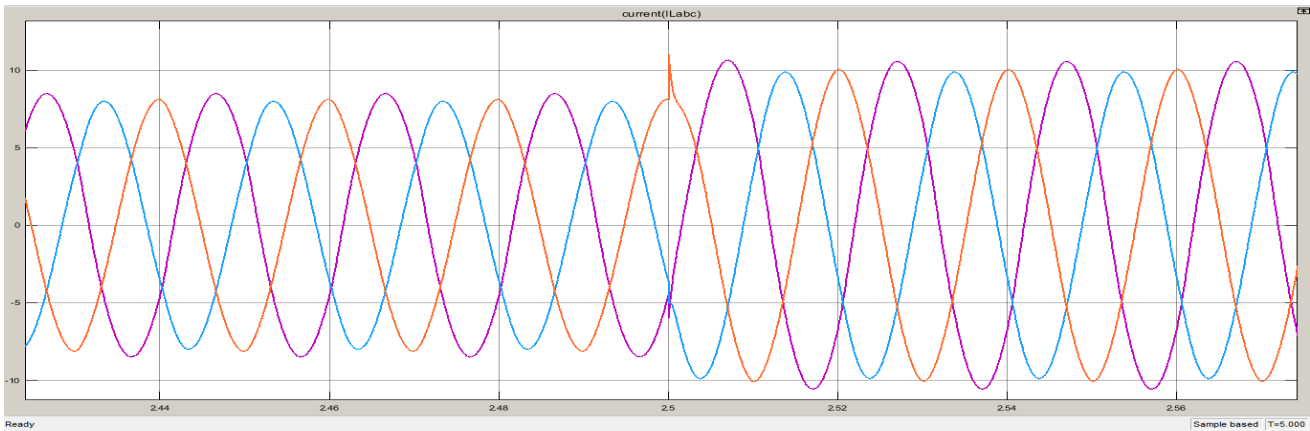


Fig 13 Current($I_{L, abc}$)

We also examined the effect of changes in network frequency. frequency changes from 48: 5 Hz to 50 Hz at 0: 8 s, or returns to 49: 5 Hz at 0: 85 s. You can see in Figure 14 that VSI quickly synchronizes the frequency of the new network. Therefore, we can determine that the planned control process has the potential for change in network events. In this case, we also use different BPF parameters (e.g 0: 3). It appears that when network events change, both are active or mercurial forces.

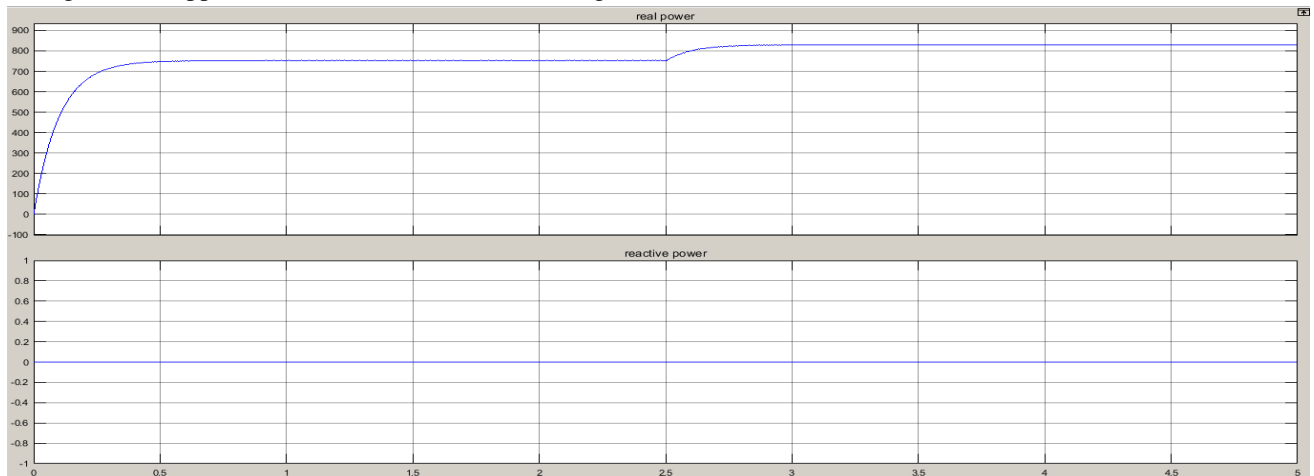


Fig14 Real And Reactive Power (P,Q)

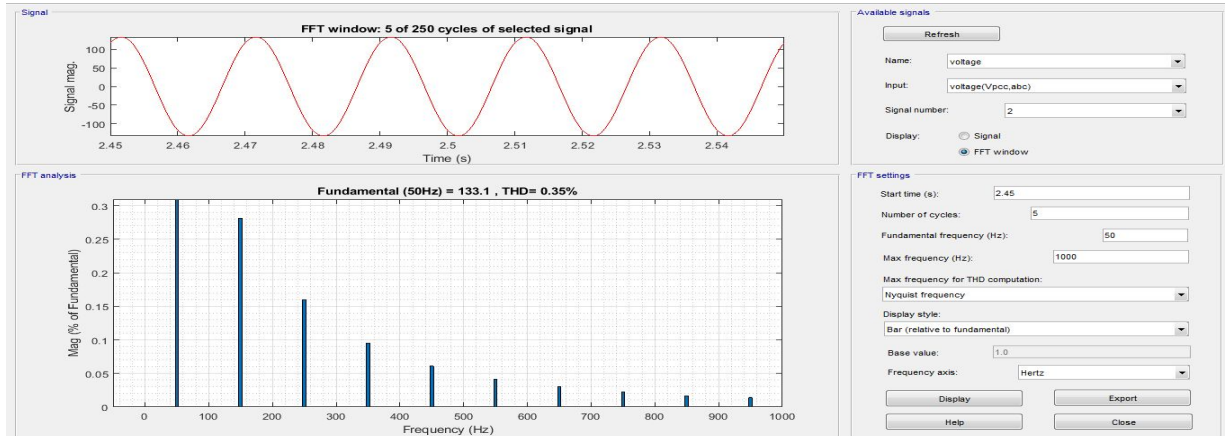


Fig 15 Total Harmonic Distortion (THD)

Stabilization Analysis In this section, we use the proposed method to study the eigenvalue of error force. Based on these eigenvalues, we look at the weak VSI resistance associated with the network. First, let us explain the purpose of the BPF transfer used in this study as follows:

$$G_{bpf} = \frac{2\omega_c s}{s^2 + 2\omega_c s + \omega_0^2},$$

Where $\omega_c = \zeta\omega_0$ is the resonance bandwidth, ω_0 the frequency of resonance, and ζ decreases the rate

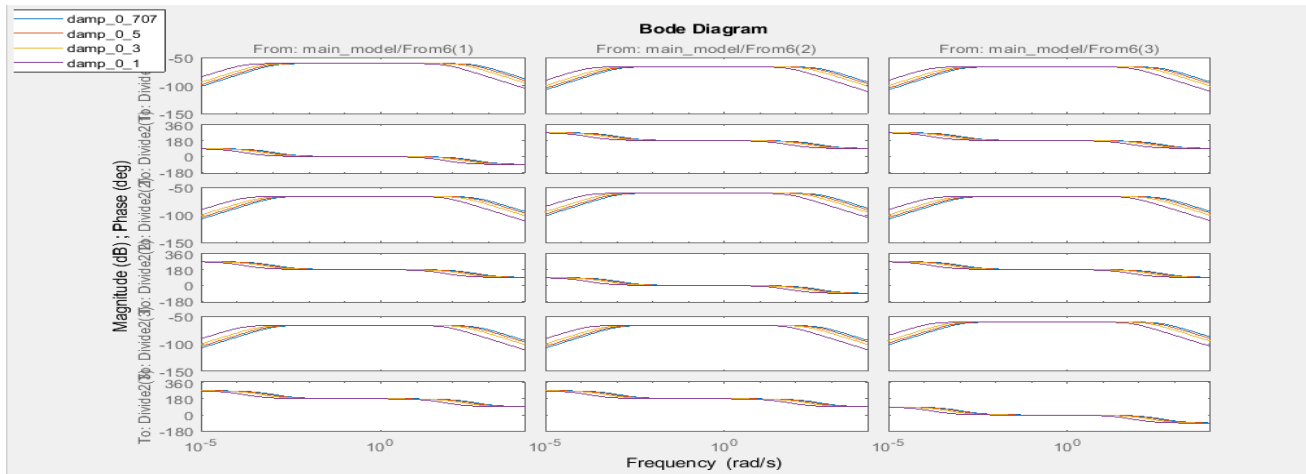


Fig 16 damping ratio

IV CONCLUSIONS

This article outlines a VM-DPC third-party VSI-linked VM-DPC network, in which the PLL system can make the system unbalanced. We use BPF to connect a powerless network to a VSI system to use the GVM-DPC concept. With a complete analysis based on eigenvalues, the system remains stable within a functional range. Also, to incorporate active operating power into a weak grid, the system must produce a guaranteed amount of critical voltage resistance control in the PCC. Finally, reproduction or new results show that the proposed method works well on weak grids. In the proposed method, tested with a DC link should work on multiple outputs. for single-phase home applications. This document introduces the concept of a new series of Microgrid controllers for DC. Topologically, this is a split of a dual active bridge (DAB) or a full DC / DC bridge that is compatible with the same input or exit mode. The dc / dc converter can generate positive or negative voltages, so it can control the flow of power back and forth during brownout and brownout, respectively. The switching of the switching function to the DAB occurs at zero voltage, which allows for a variable converter loss

REFERENCE

- [1] Wenxiang Zhou ; Fei Li ; Xing Zhang ; Peng Liu ; Jun Xu ; Yang Liu Voltage Source Active Damper Applied to Resonance Suppression of Multi-inverter Grid-connected 2018 IEEE International Power Electronics and Application Conference and Exposition (PEAC) Year: 2018 ISBN: 978-1-5386-6054-6 DOI: 10.1109/IEEE Shenzhen, China
- [2] Jiangfeng Wang ; Jianhui Yao ; Haibing Hu ; Yan Xing ; Xiaobin He ; Kai Sun impedance-based stability analysis of single-phase inverter connected to weak grid with voltage feed-forward control 2016 IEEE Applied Power Electronics Conference and Exposition (APEC) Year: 2016 ISBN: 978-1-4673-9550-2 DOI: 10.1109/IEEE Long Beach, CA, USA
- [3] Aswad Adib ; FaribaFateh ; Mohammad B. Shadmand ; BehroozMirafzalWeak Grid Impacts on Stability of Voltage Source Inverters —Asymmetrical Grid 2018 IEEE Energy Conversion Congress and Exposition (ECCE) Year: 2018 ISBN: 978-1-4799-7312-5 DOI: 10.1109/IEEE Portland, OR, USA
- [4] Yan Du ; Linbo Cui ; Xiangzhen Yang ; Jianhui Su ; Fei Wang Impedance-phase reshaping of LCL-filtered grid-connected inverters to improve the stability in a weak grid 2017 IEEE Energy Conversion Congress and Exposition (ECCE)Year: 2017 SBN: 978-1-5090-2998-3DOI: 10.1109/ IEEE Cincinnati, OH, USA
- [5] J. M. Carrasco et al., “Power-electronic systems for the grid integration of renewable energy sources: A survey,” IEEE Trans. Ind. Electron., vol. 53, no. 4, pp. 1002–1016, Jun. 2006.
- [6] F. Blaabjerg, Z. Chen, and S. B. Kjaer, “Power electronics as efficient interface in dispersed power generation systems,” IEEE Trans. Power Electron., vol. 19, no. 5, pp. 1184–1194, Sep. 2004.
- [7] J. Rocabert, A. Luna, F. Blaabjerg, and P. Rodriguez, “Control of power converters in AC microgrids,” IEEE Trans. Power Electron., vol. 27, no. 11, pp. 4734–4749, Nov. 2012. [4] G. Shen, D. Xu, L. Cao, and X. Zhu, “An improved control strategy for grid-connected voltage source inverters with an LCL filter,” IEEE Trans. Power Electron., vol. 23, no. 4, pp. 1899–1906, Jul. 2008.
- [8] Y. Tang, P. C. Loh, P. Wang, F. H. Choo, and F. Gao, “Exploring inherent damping characteristic of LCL-filters for three-phase grid-connected voltage source inverters,” IEEE Trans. Power Electron., vol. 27, no. 3, pp. 1433–1443, Mar. 2012.
- [9] J. Yin, S. Duan, and B. Liu, “Stability analysis of grid-connected inverter with LCL filter adopting a digital single-loop controller with inherent damping characteristic,” IEEE Trans. Ind. Informat., vol. 9, no. 2, pp. 1104–1112, May 2013.
- [10] J. Kukkola, M. Hinkkanen, and K. Zenger, “Observer-based state-space current controller for a grid converter equipped with an LCL filter: Analytical method for direct discrete-time design,” IEEE Trans. Ind. Electron., vol. 51, no. 5, pp. 4079–4090, Sep./Oct. 2015.
- [11] D. Yang, X. Ruan, and H. Wu, “Impedance shaping of the grid-connected inverter with LCL filter to improve its adaptability to the weak grid condition,” IEEE Trans. Power Electron., vol. 29, no. 11, pp. 5795–5805, Nov. 2014.
- [12] G. Qi, A. Chen, and J. Chen, “Improved control strategy of interlinking converters with synchronous generator characteristic in islanded hybrid AC/DC microgrid,” CPSS Trans. Power Electron. Appl., vol. 2, no. 2, pp. 149–158, Jun. 2017.
- [13] C. Zheng, L. Zhou, X. Yu, B. Li, and J. Liu, “Online phase margin compensation strategy for a grid-tied inverter to improve its robustness to grid impedance variation,” IET Power Electron., vol. 9, no. 4, pp. 611–620, Mar. 2016.
- [14] F. Blaabjerg, R. Teodorescu, M. Liserre, and A. V. Timbus, “Overview of control and grid synchronization for distributed power generation systems,” IEEE Trans. Ind. Electron., vol. 53, no. 5, pp. 1398–1409, 2006.
- [15] F. Blaabjerg, M. Liserre, and K. Ma, “Power electronics converters for wind turbine systems,” IEEE Trans. Ind. Appl., vol. 48, no. 2, pp. 708–719, 2012.
- [16] Y. Gui, W. Kim, and C. C. Chung, “Passivity-based control with nonlinear damping for type 2 STATCOM systems,” IEEE Trans. PowerSyst., vol. 31, no. 4, pp. 2824–2833, 2016.
- [17] F. Blaabjerg, Y. Yang, D. Yang, and X. Wang, “Distributed powergenerationsystems and protection,” Proc. IEEE, vol. 105, no. 7, pp.1311–1331, 2017.
- [18] X. Guo, B. Wei, T. Zhu, Z. Lu, L. Tan, X. Sun, and C. Zhang, “Leakage current suppression of three-phase flying capacitor PV inverter with new carrier modulation and logic function,” IEEE Trans. Power Electron.,vol. 33, no. 3, pp. 2127–2135, 2018.
- [19] Y. Gui, B. Wei, M. Li, J. M. Guerrero, and J. C. Vasquez, “Passivitybasedcoordinated control for islanded AC microgrid,” Appl. Energy,vol. 229, pp. 551–561, 2018.



10.22214/IJRASET



45.98



IMPACT FACTOR:
7.129



IMPACT FACTOR:
7.429



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24*7 Support on Whatsapp)