



iJRASET

International Journal For Research in
Applied Science and Engineering Technology



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Volume: 2

Issue: V

Month of publication: May 2014

DOI:

www.ijraset.com

Call:  08813907089

E-mail ID: ijraset@gmail.com

Design Study of Environment Friendly Vapor Absorption Refrigeration System of a Unit Capacity using Li- Br and Water as Working Fluid

Sachin Kaushik¹, Dr. S. Singh²

1 (M. Tech Scholar, Department of Mechanical Engineering)

2 (Associate Professor, Department of Mechanical Engineering)

BipinTripathiKumaon Institute of Technology, Dwarahat, Almora, Uttarakhand (India) 263653

Abstract—The objective of this paper is to design and study an environment friendly vapour absorption refrigeration system of unit capacity using Li- Br and water as the working fluids. The thermodynamic design of Li Br-water absorption refrigeration systems is usually based on assumed steady-state operating conditions. Absorber, condenser and evaporator temperatures are fixed as well as the temperature approach in the solution heat exchanger. System refrigerating capacity is also known 1.5 ton and then final design parameters are illustrated.

Keywords—Solar absorption refrigeration, Thermodynamic design, Low grade energy, Li-Br & Water.

I. INTRODUCTION

In recent developments of thermal engineering the Refrigeration technologies play an important role in today's industrial applications [1].

Design of refrigeration systems for cold storage to provide safety, economy, and reliability. Refrigeration design is a specialized field of thermal engineering. The design of cold storage refrigerated systems should be performed by an experienced refrigeration design engineer. A “plan and specify” or a “design-build” arrangement can perform the refrigeration design. Design-build has been the trend of the refrigeration industry. In many cases, equipment manufacturers have significantly supported the refrigeration design.

In this paper, we have explained the design of a vapour absorption refrigeration system. For this work firstly we have gone through the basic theoretical study of the refrigeration system. The complete analytic study with the required formulas, explanation of the refrigeration cycles and the initial parameters are explained in [2]. Then we have gone for the design of the basic components.

Design is considered to be the most important step in deciding the performance of a component. Any component before its fabrication has to be designed and actual working of a component depends upon how correctly and accurately the component has been designed.

In general design of a component involves determining important parameters like heat transfer coefficients, heat transfer area, diameter of the, length etc. of the components. Design is the main part of this work so a detail design study of each component of the system has been done and explained in the next section [3].

II. DESIGN OF THE SYSTEM

General: All the components are experiencing some sort of heat exchanges. Thus all components are basically Heat Exchangers. Now there are two broad classification of Heat Exchangers, option is to design for concentric tubes (Double Pipe) type Heat Exchanger or Shell and tube type of Heat Exchanger [4]. But in general Shell and tube Heat Exchanger is preferred over ordinary Double pipe due to many factors like shell-and-tube heat

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

exchanger provides fairly large ratios of heat transfer area to volume and weight. It provides this surface in a form that is relatively easy to construct in a wide range of sizes and that is mechanically rugged enough to withstand normal shop fabrication stresses, external and internal stresses encountered under normal operating conditions, easy dismantling for cleaning and repair work. Moreover the type of the tube and flow arrangement required for various processes like condensation, absorption etc. taking place in the system does not permit the use of Double Pipe type Heat Exchanger. Therefore it is better to design considering Shell and tube Heat Exchanger[5].

Criteria For A Successful Heat Exchanger Design

It must be able to perform given heat duty and to retain the capability to do this in the presence of fouling until the next scheduled maintenance period. The second criterion is that the heat exchanger must withstand the service conditions of the plant environment. The immediate consideration here is the mechanical stresses, there are external mechanical stresses imposed by the piping on the exchanger by both steady state and transient flow and temperature variations of the streams. The exchanger must resist corrosion by the service and process streams and by the environment. Third, the exchanger must be maintainable, which usually means choosing a configuration that permits cleaning as required and replacement of tubes, gaskets, and any other

Table 1 : Tube sheet layout (number of tubes) (square pitch arrangement).

components that are especially vulnerable to corrosion, erosion, vibration, or aging. Fourthly, the exchanger should cost as little as possible, consistent with the above criteria being satisfied[6].

Basic Construction of a Shell and Tube Heat type Exchanger:

The main parts of a Shell and Tube Heat Exchanger are

- i) Shell
- ii) Tubes
- iii) Baffles
- iv) Tube-sheet

General Design Procedure:

The design of a heat exchanger component generally involves finding the important parameters like Heat transfer coefficients h , heat transfer Area, Length of tubes L , Number of tubes N_t . Although there are small differences in design of above mentioned components, a general procedure for Design of Shell and tube Heat Exchanger can be stated as follows.

1. The characteristics of fluids contribute to a fundamental property of heat exchangers—
The Heat Transfer rate (Q). The heat transferred to the colder fluid must equal that transferred from the hotter fluid, according to the following equation:

$$Q = m_{\text{hot}} \times C_{p,\text{hot}} \times (T_{\text{hot,in}} - T_{\text{hot,out}}) = m_{\text{cold}} \times C_{p,\text{cold}} \times (T_{\text{cold,out}} - T_{\text{cold,in}})$$

$$Q = UAF(LMTD)$$

The various symbols in these equations have their usual meanings. The symbol ' F ' stands for a Correction Factor that must be used with the log mean temperature difference for a counter-current heat exchanger to accommodate the fact that the flow of the two streams here is more complicated than simple counter-current or co-current flow. The

LMTD was developed for a model restricted to parallel and counter-current flow patterns. In shell and tube exchangers, the flow pattern is a mixture of co-current, counter-current, and crossflow, so the LMTD does not directly apply. Instead, a *corrected LMTD* must be used.

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

This has been clearly illustrated in the figure below for 1-

i. Tube OD, mm. Two most commonly used tube OD are

Tube OD, mm \ Shell Diameter, mm	Pitch mm		19		25.4		31		38.1	
	1P	2P	1P	2P	1P	2P	1P	2P	1P	2P
203.2	32	26	21	16	-	-	-	-	-	-
254.0	52	52	32	32	16	12	-	-	-	-
304.0	81	76	48	45	30	24	16	16	-	-
336.6	97	90	61	56	32	30	22	22	-	-
387.4	137	124	81	76	44	40	29	29	-	-
438.2	177	166	112	112	56	53	39	39	-	-
489.0	224	220	138	132	78	73	48	48	-	-
539.8	277	270	177	166	96	90	60	60	-	-
590.6	341	324	213	208	127	112	74	74	-	-
635.0	413	394	260	252	140	135	90	90	-	-

1(1-Pass 1-Tube) Shell and Tube heat exchanger. The Correction Factor (F) can be determined from Correction Factor Charts after calculating two non-dimensional parameters P and Z

2. From the Tube-Sheet Layout Table 1 (from Heat Transfer Design Data Book by Domkundwar and Domkundwar) select the following parameters

19mm and 25.4mm.

ii. Number of Tubes, $t N$

iii. Number of Tube Pass, P

iv. Shell Diameter, $S D$ mm

Tube Layout: There are four tube layout patterns, as shown in Figure 3.5: triangular (30°), rotated triangular (60°), square (90°), and rotated square (45°).

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

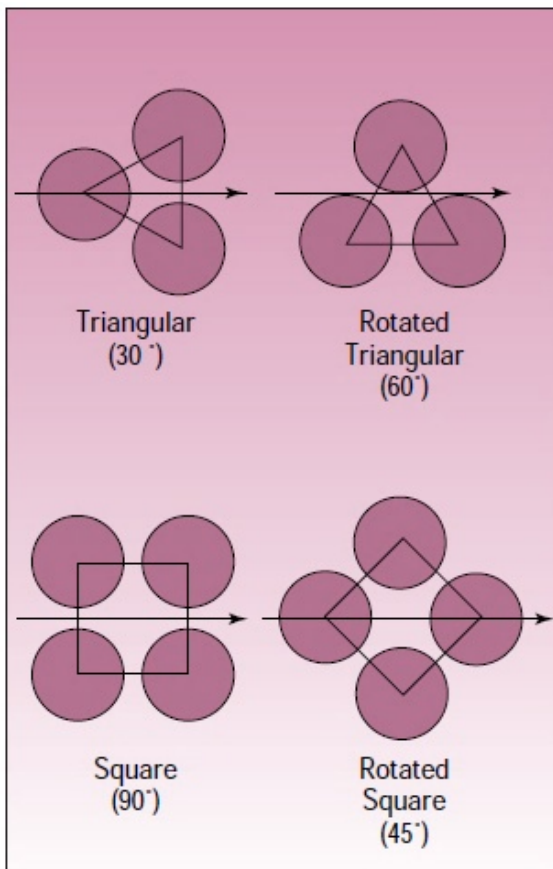


Fig.3.5:Types of tube layouts

A triangular (or rotated triangular) pattern will accommodate more tubes than a square (or rotated square) pattern. However, at the typical tube pitch of 1.25 times the tube O.D, it does not permit mechanical cleaning of tubes, since access lanes are not available.

Consequently, a triangular layout is limited to clean shell-side services. For services that require mechanical cleaning on the shell-side, square patterns must be used.

Pitch: Tube pitch is defined as the shortest distance between two adjacent tubes. TEMA specifies a minimum tube pitch of 1.25 times the tube O.D. (Heat exchanger configurations are defined by the numbers and letters established by the Tubular Exchanger Manufacturers Association (TEMA)).

Wall Thickness of tubes: The wall thickness is defined by the Birmingham wire gage (BWG).

Table 2: Tube diameter and thickness table (Design and Rating Shell and Tube Heat Exchangers by John E Edwards)

Tube OD,in	BWG	Thickness ,in	Tube ID,in
0.5	12	0.109	0.282
	14	0.083	0.334
	16	0.065	0.370
	18	0.049	0.402
	20	0.035	0.430
	10	0.134	0.482
0.75	11	0.120	0.510
	12	0.104	0.532
	13	0.095	0.560
	14	0.083	0.584
	15	0.072	0.606
	16	0.065	0.620
1	8	0.165	0.670
	9	0.148	0.704
	10	0.134	0.760
	11	0.120	0.783
	12	0.109	0.810
	13	0.095	0.834
	14	0.083	0.856

3. Tube side Heat Transfer Coefficient, h_i : It is simply the case of flow through cylindrical tubes. The tube side heat-transfer coefficient is a function of the Reynolds number, Re , the Prandtl number, Pr .

These can be broken down into the following fundamental parameters:

physical properties (namely viscosity, thermal conductivity, and specific heat); tube diameter, flow velocity. For turbulent flow through pipes ($Re > 2300$)

Nusselt Number
 $Nu = 0.023 (Re)^{0.8} (Pr)^{0.4}$

where $Re = \rho V d_i / \mu$ and $Pr = \mu C_p / k$

For Laminar Flows

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

$$Nu = hi d/k = 3.66 \text{ (For fully developed flow)}$$

(Turbulent flow is usually preferred because it involves high heat transfer coefficients)[7].

4. Shell side Heat Transfer Coefficient, h_o : The shell side calculations are far more complex than those for the tube-side because of the involvement of various tube layout patterns, baffledesigns which together determine the shell side stream analysis. In a heat exchanger that involves tube banks, the tubes are placed in a shell and the fluid flows through the spaces between the tubes.

It is the case of flow across tube banks. Now the flow can be analyzed by two methods. One method is given in book by Cengel and other given in the book by Holman.

We can use any of the method to calculate shell side heat transfer coefficient.

Heat Transfer Correlations given in the book by Cengel:
The correlation given in book by Cengel is

$$Nu = hD/k = C Re_D^m Pr^n (pr/pr_s)^{0.25} \text{ (Zukauskas, 1987)}$$

The value of C , m and n depends upon the value of Reynolds number.

Table 3 :Nusselt number correlations for cross flow over tube banks for number of rows
> 16 and $0.7 < Pr < 500$ for In-line tube arrangement

Range of Re_D	Correlation
0-100	$Nu_D = 0.9 Re_D^{0.4} Pr^{0.36} (Pr/Pr_s)^{0.25}$
100-1000	$Nu_D = 0.52 Re_D^{0.5} Pr^{0.36} (Pr/Pr_s)^{0.25}$
1000- 2×10^5	$Nu_D = 0.27 Re_D^{0.63} Pr^{0.36} (Pr/Pr_s)^{0.25}$
$2 \times 10^5 - 2 \times 10^6$	$Nu_D = 0.27 Re_D^{0.8} Pr^{0.4} (Pr/Pr_s)^{0.25}$

Here Reynolds number is defined on the basis of maximum velocity V and not the approach velocity V . This is because if we consider the diagram below as the fluid enters the tube bank the flow area decreases from $S_T \times L$ to $(S_T - D)L$ between the tubes hence the flow velocity increases. The maximum velocity is determined from conservation of mass requirement

$$\text{i.e. } \rho A_1 V = \rho A_T V_{\max} \text{ or } S_T \times V = (S_T - D) V_{\max}$$

Therefore the maximum velocity is given by

$$V_{\max} = S_T / (S_T - D) \times V$$

Hence the Reynolds number is calculated on the basis of V_{\max} as

$$Re = (\rho V_{\max} D) / \mu$$

Now the Nusselt number in the table above is for 16 or more rows. For less number of rows, Nusselt number is to be multiplied by a Correction Factor F .

Table 4: Correction factor

N	1	2	3	4	5	7	10	13
In-line	0.70	0.80	0.86	0.90	0.93	0.96	0.98	0.99

N = Number of rows

Heat Transfer Correlations given in the book by Holman: The correlation given in

Holman's book is

$$Nu = h_o D_o / K = C Re^n Pr^{1/3}$$

The Reynolds number, $Re = (\rho V_{\max} D_o) / \mu$, where D_o is the outside diameter of a tube. V_{\max} is the "maximum" velocity of the fluid through the tube bank. To find it, first, the cross-flow area must be evaluated. This is given as Cross flow area = Shell ID \times Baffle spacing \times Clearance / Pitch, where the clearance l and pitch $n S$ (normal to the flow direction) are illustrated below for tubes in a square pitch.

Diagram showing tube clearance and Pitch

The clearance $l = S_n - D_o$ When the volumetric flow rate of the shell-side fluid is

divided by the cross-flow area defined here, it yields the "maximum velocity" through the tube bank. All the properties should be evaluated at the arithmetic average temperature of that fluid between the two end temperatures. The exponent n and the multiplicative constant C depend on the pitch to tube OD ratio, and are given in a table 5, table 6 provided in Holman's book.

Table 5: Value of constant C

S_n/D_o	1.25	1.5	2.0	3.0
S_p/D_o				
1.25	0.386	0.305	0.111	0.0703
1.5	0.407	0.278	0.112	0.0753
2.0	0.464	0.332	0.254	0.220
3.0	0.322	0.396	0.415	0.317

Table 6: Value of constant n

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

S_n/D_0	1.25	1.5	2.0	3.0
S_p/D_0				
1.25	0.592	0.608	0.704	0.752
1.5	0.586	0.620	0.702	0.744
2.0	0.570	0.602	0.632	0.648
3.0	0.601	0.584	0.581	0.608

5. Calculation of Overall Heat transfer coefficient, U : When we have the value of h_i and h_0 we can calculate the overall heat transfer coefficient by the relation

$$U = \frac{1}{\left(\frac{1}{h_0}\right) + \left(\frac{r_0}{k} \times \ln \frac{r_0}{r_i}\right) + \left(\frac{r_0}{r_i} \times \frac{1}{h_i}\right)}$$

Fig 3.8 Diagram showing the thermal resistances

6. Calculation of LMTD

Fig.3.9 Temperature changes during (a) Counter Flow and (b) Parallel Flow

$$\Delta T_m = LMTD = (\theta_1 - \theta_2) / \ln (\theta_1 / \theta_2)$$

7. Calculation of Surface area required,
 $A_0 = (Q / U_0 F \Delta T_m)$

8. Calculation of Length, L of the tubes by the relation, $A_0 = N_t \times \pi \times d_0 \times L$

Design of Condenser: In the condenser the saturated water vapours coming from the Generator are pass over cooling water pipes and are condensed to form saturated liquid water. The water vapors give up their heat of condensation and the cooling water takes away this heat. The cooling water used is same that is coming from the Absorber outlet. Here saturated water vapours entering the condenser is the hot fluid and external incoming cold water is the cold fluid.

Condensing temperature, $T_{hi} = T_{ho} = 300C$

Cooling water inlet temperature, $T_{ci} = 17.40C$ (outlet water temperature of Absorber)

Let cooling water outlet temperature, $T_{co} = ?$

Choosing a heat exchanger with the following characteristics from the Tube Sheet Layout (Table 1)

Tube OD, $d_0 = 25.4mm$

Taking BWG = 14, Thickness = 2.11mm

Tube ID, $d_i = 21.18mm$

Number of Passes, $P = 2$

Number of Tubes, $N_t = 16(4 \times 4)$

Inner Shell Diameter, $D_s = 203.2mm$

Pitch, $P_t = 1.25d_0 = 1.25 \times 25.4 = 31.75mm$.

Final design results for Condenser

1. OD of tubes = 25.4mm

2. ID of Tubes = 21.18mm

3. Number of Tubes = 16

4. Number of Tube Pass = 2

5. Shell Diameter = 203.2mm

6. Heat transfer surface area = 0.644m²

7. Length of each tube per pass = 25.5cm

Design of Absorber

In the absorber, the water vapour produced by the evaporator is absorbed by a concentrated strong lithium bromide solution falling in the form of fine droplets over cooled horizontal tubes. The absorption of vapour in the liquid film is an exothermic process. The coolant water flowing through the tubes remove the excess heat produced due to absorption. Choosing a heat exchanger with the following characteristics from the Tube Sheet Layout

Table 1

Tube OD, $d_0 = 25.4mm$

Taking BWG = 10, Thickness = 3.4mm

Tube ID, $d_i = 18.6mm$

Number of Passes, $P = 2$

Number of Tubes, $N_t = 16(4 \times 4)$

Inner Shell Diameter, $D_s = 203.2mm$

Pitch, $P = 1.25d_0 = 1.25 \times 25.4 = 31.75mm$

Tube side heat transfer coefficient, i_h :

Now, heat of absorption = heat taken by cooling water

i.e. $Q = m_w \times c_{pw} \times (T_{co} - T_{ci})$

Let inlet temperature of cooling water = 16^oC

Here two unknowns are present m_w and T_{co} , one parameter has to be assumed.

Taking $m_w = 1 \text{ kg / s}$

Final specifications for Absorber

1. OD of tubes = 25.4mm

2. ID of Tubes = 18.6mm

3. Number of Tubes = 16

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

4. Number of Tube Pass = 2
5. Shell Diameter = 203.2mm
6. Heat transfer surface area = 2.81m²
7. Length of each tube per pass = 110cm

Design of Evaporator: In the evaporator saturated liquid water enters at the top of the shell and falls over chilled water pipes and boils into saturated water vapors' by taking heat of chilled water and hence producing refrigerating effect. Here saturated water entering the evaporator from the top is the cold fluid and water to be cooled/chilled is the hot fluid.

Evaporator temperature, $T_e = 4^\circ\text{C}$
 Inlet temperature of chilled water, $T_{ci} = 20^\circ\text{C}$
 Outlet temperature of chilled water, $T_{co} = ?$ Tube OD, $d_o = 25.4\text{mm}$

Taking BWG = 8, Thickness = 4.19mm

Tube ID, $d_i = 17.02\text{mm}$

Number of Passes, $P = 2$
 Number of Tubes, $N_t = 16$ (4×4)
 Inner Shell Diameter, $D_s = 203.2\text{mm}$
 Pitch, $P = 1.25d_o = 1.25 \times 25.4 = 31.75\text{mm}$

Final design results for Evaporator

1. OD of tubes = 25.4mm
2. ID of Tubes = 17.02mm
3. Number of Tubes = 16
4. Number of Tube Pass = 2
5. Shell Diameter = 203.2mm
6. Heat transfer surface area = 2.12m²
7. Length of each tube per pass = 83cm

Design of Generator: The construction of the generator consists of horizontal tubes through which hot water flows. Weak solution of Li-Br is sprayed from the top of the shell through spray header onto hot water tubes. Vaporization (Boiling) of weak solution produces pure water vapors to form strong solution which is collected at the base of shell. The water vapors produced at 64°C move out of the shell towards the condenser. Here weak solution entering the Generator is the cold fluid and external hot incoming water is hot fluid.
 Outlet temperature of strong solution,
 $T_{co} = 64^\circ\text{C}$

Inlet temperature of weak solution, $T_{ci} = ?$

Inlet temperature of hot water, $T_{hi} = 68^\circ\text{C}$

Outlet temperature of hot water, $T_{ho} = ?$

Table 7 : Final design parameters.

S.N O	COMPONENTS	Evaporator	Absorber	Generator	Condenser
	Design Parameter				
1	OD of Tubes (mm)	25.4	25.4	19	25.4
2	ID of Tubes (mm)	17.02	18.6	14.84	21.18
3	Number of Tubes	16	16	26	16
4	Number of Tube pass	2	2	2	2
5	Shell Diameter (m)	203.2	203.2	203.2	203.2
6	Heat Transfer Surface Area (m ²)	2.12	2.81	1.28	0.644
7	Length of each tube per pass (cm)	83	110	41.3	25.5

Final design results for Generator

1. OD of tubes = 19mm
2. ID of Tubes = 14.84mm
3. Number of Tubes = 26
4. Number of Tube Pass = 2
5. Shell Diameter = 203.2mm
6. Heat transfer surface area = 1.28m²
7. Length of each tube per pass = 41.3cm [8].

III. RESULT AND DISCUSSIONS

A general design procedure has been defined and then design is carried out of each of the five components in accordance with the laid down procedure. A general procedure for the design and initial parametric values and the final design parametric values in given and explained in the above section .

INTERNATIONAL JOURNAL FOR RESEARCH IN APPLIED SCIENCE AND ENGINEERING TECHNOLOGY (IJRASET)

For the better understanding of the results we have given a design parameters table 7.

IV. CONCLUSIONS

A configuration of a simple LiBr/H₂O absorption system is developed in this work. The values of the physical parameters are calculated analytically and shown in the respective section.

REFERNCES

[1] S. S. Mali, M. M. Wagh, N. N. Singhe “Review Of Designing Of Single Effect Solar Powered Vapour Absorption Air Conditioning System”, *International Journal Of Advanced Research In Science And Engineering*, Vol.-2, Issue-7, 2013.

[2] Sachin Kaushik, Dr. S. Singh “Thermodynamic Analysis Of Vapour Compression Refrigeration System And Calculation of COP” *International Journal For Research In Applied Science And Engineering Technolgy*, Vol 2 Issue 11, 2014, Pp- 73-79.

[3] Sachin Kaushik, K.S. Mehra, Dr. S. Singh “Thermal Analysis for Various Materials and Alloys” *International Journal of Engineering Research & Technology (IJERT)*, Vol. 2 Issue 11, November – 2013, Pp 71-76.

[4] S. Jain And C. W. Bullard “Optimization Of Heat Exchanger Design Parameters For Hydrocarbon Refrigerant Systems”, *Air Conditioning And Refrigeration Center University Of Illinois Mechanical & Industrial Engineering Dept.* 1206 West Green Street Urbana.

[5] Rajiv Mukherjee “Effectively Design Shell-And-Tube Heat Exchangers” *Chemical Engineering Progress*, February 1998.

[6] A. Bartlett “The Fundamentals Of Heat Exchangers” *The Industrial Physicist, American Institute Of Physics*, 1996.

[7] Crishtopher Haslego, Rgaham Polley “Designing Palte And Frame Heat Exchangers”, *CEP*, 2002.

[8] John E. Edwards John E “Design And Rating Shell And Tube Heat Exchangers” *MLN 032a* Issued 29 August 08.



10.22214/IJRASET



45.98



IMPACT FACTOR:
7.129



IMPACT FACTOR:
7.429



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24*7 Support on Whatsapp)