



# IJRASET

International Journal For Research in  
Applied Science and Engineering Technology



---

# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

---

**Volume: 5      Issue: VI      Month of publication: June 2017**

**DOI:**

**[www.ijraset.com](http://www.ijraset.com)**

**Call:  08813907089**

**E-mail ID: [ijraset@gmail.com](mailto:ijraset@gmail.com)**

# A Review on Enhancing the Performance of MPPT for Single Stage PV-Grid Connected System Using Particle Swarm Optimization Technique

Ms. Trivelli Shekhar Naidu<sup>1</sup>, Prof. Bushra Khan<sup>2</sup>, Prof. Radharaman Shah<sup>3</sup>

<sup>1,2,3</sup>Department of Electrical Engineering (IPS), Abha Gaiwad Patil College of Engineering, RTMNU

**Abstract:** The scaling of maximum power point tracking (MPPT) system is suggested. The optimal operating point of a solar module is known as the maximum power point (MPP) and it changes with its own characteristic as well as cell temperature and sunlight. The scaling S-PVMPPT algorithm is modified algorithm to achieve MPPT in spite of single or 80 micro-meter up to 4 decimal places, that is, an error no bigger than  $10^{-4}$ , the Trapezoidal Rule, we could take big enough so that  $1/n2 \leq 10^{-4}$  solar PV cells. The most important rule, in practice, is the Simpson's Rule, because of its simplicity and accuracy. From the simulation and experimental results, the particle swarm optimization (PSO) based maximum power point tracking (MPPT) for PV system is presented which is interrelated with other control schemes such as synchronization with grid and current control finding lower error event as compare with PV-MPPT with same saturated voltage and it can deliver more power than the conventional MPPT Technique.

**Keywords—** Maximum Power Point Tracking (MPPT), Photovoltaic (PV), Particle Swarm Optimization (PSO), Trapezoidal rule, Simpson's rule

## I. INTRODUCTION

The voltage-power specific of a photovoltaic (PV) array is nonlinear and time varying because of the changes caused by the atmospheric conditions. The task of a Maximum Power Point (MPP) Tracking (MPPT) in a PV power system is to constantly tune the system so that it draws maximum power from the PV array. In current years, the Simpson-PVMPPT systems have developed more popular because they do not need battery backups to ensure MPPT. The two typical outlines of a Simpson-PV-MPPT system are single or two stages. In two stages, the first is used to boost the PV array voltage and track the maximum power; the second permits the adaptation of this power into high-quality AC voltage. The incidence of numerous power phases undermines the overall efficiency, reliability, and compactness of the system besides increasing the cost. The single stage has frequent, advantages, such as simple topology, high efficiency, etc. Nevertheless, the control strategy has to be calculated in order to remove the maximum available power and to properly transfer it from the PV array to the grid simultaneously. In this case, an important consideration in the controller design is needed.

## II. SOLAR CELL AND PV ARRAY MODULE

PV generator is a combination of solar cells, connections, protective parts, supports, etc. In the present modelling, the focus is only on cells. Solar cells consist of a p-n junction; various modelling of solar cells have been proposed in the literature [14]–[16]. Thus, the simplest equivalent circuit of a solar cell is a current source in parallel with a diode. The output of the current source is directly proportional to the light falling on the cell (photocurrent). During darkness, the solar cell is not an active device; it works as a diode, i.e., a p-n junction. It produces neither a current nor a voltage. Thus, the diode determines the  $I$ - $V$  characteristics of the cell. For this paper, the electrical equivalent circuit of a solar cell is shown in Figure 1 The output current  $I$  and the output voltage of a solar cell are given by

$$I = I_{ph} - I_{d0} - V_{d0}/R_{sh} \text{-----}(1)$$

$$= I_{ph} - I_0 \left( \exp \left( \frac{q \cdot V_{d0}}{n \cdot k \cdot T} \right) - 1 \right) - \frac{V_{d0}}{R_{sh}} \text{-----}(2)$$

$$V = V_{d0} - R_s I \text{-----}(3)$$

Here,  $I_{ph}$  is the photocurrent,  $I_0$  is the reverse saturation current,  $I_{d0}$  is the average current through the diode,  $n$  is the diode factor,  $q$  is the electron charge ( $q = 1.6 \times 10^{-19}$ ),  $k$  is

## International Journal for Research in Applied Science & Engineering Technology (IJRASET)

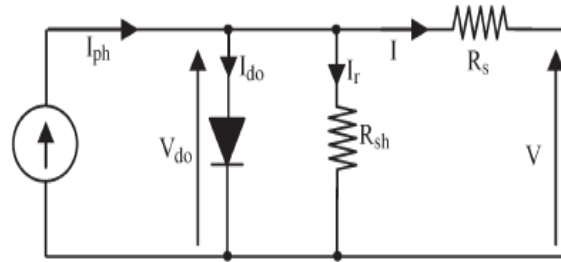


Figure II.a: Solar cell electrically equivalent circuit.

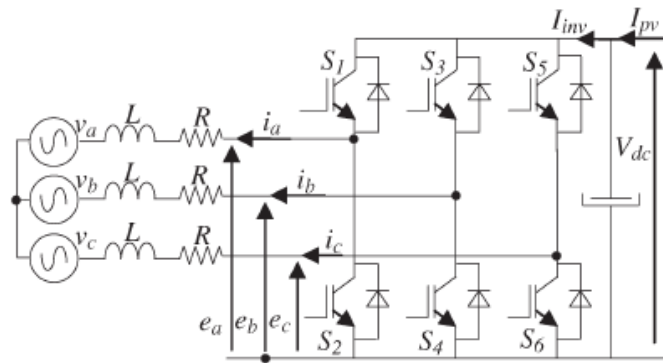


Figure II.b: Three-phase VSI.

the Boltzmann's constant ( $k = 1.38 \cdot 10^{-23}$ ), and  $T$  is the solar array panel temperature.  $R_s$  is the intrinsic series resistance of the solar cell; this value is normally very small.  $R_{sh}$  is the equivalent shunt resistance of the solar array, and its value is very large. In general, the output current of a solar cell is expressed by

$$I = I_{ph} - I_0 \left( \exp \left( \frac{q}{n \cdot k \cdot T} (V + R_s I) \right) - 1 \right) - \left( \frac{V + R_s I}{R_{sh}} \right) \quad \text{-----(4)}$$

In (4), the resistances can be generally neglected, and thus, it can be simplified to

$$I = I_{ph} - I_0 \left( \exp \left( \frac{q}{n \cdot k \cdot T} \cdot V \right) - 1 \right) \quad \text{-----(5)}$$

If the circuit is opened, the output current  $I = 0$ , and the open-circuit voltage  $V_{oc}$  is expressed by

$$V_{oc} = \left( \frac{n \cdot k \cdot T}{q} \right) \ln \left( \frac{I_{ph}}{I_0} + 1 \right) \approx \left( \frac{n \cdot k \cdot T}{q} \right) \ln \left( \frac{I_{ph}}{I_0} \right) \quad \text{-----(6)}$$

If the circuit is shorted, the output voltage  $V = 0$ , the average current through the diode is generally neglected, and the short circuit current  $I_{sc}$  is expressed by using

$$I_{sc} = I = \frac{I_{ph}}{\left( 1 + \frac{R_s}{R_{sh}} \right)} \quad \text{-----(7)}$$

Finally, the output power  $P$  is expressed by

$$P = VI = \left( I_{ph} - I_{do} - \frac{V_{do}}{R_{sh}} \right) V. \quad \text{-----(8)}$$

PV Basic Terminology

## International Journal for Research in Applied Science & Engineering Technology (IJRASET)

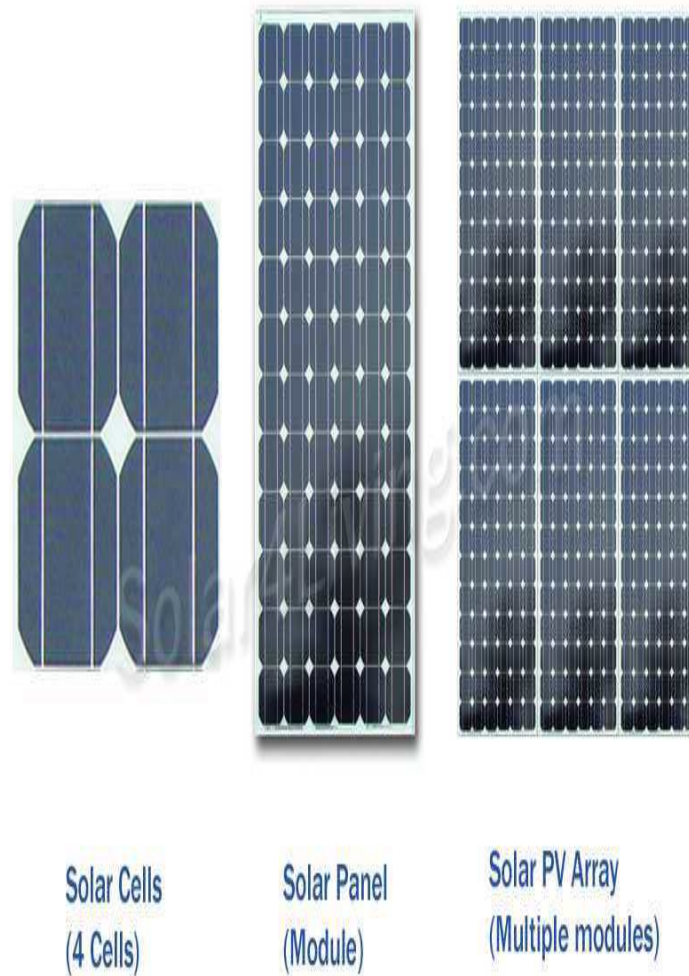


Figure 1.3: Solar Panel Basics

PV Cell: The smallest, basic photovoltaic device that converts radiation directly into electricity. Each PV cell is rated for 0.5-0.7 volt and a current of 30mA/cm<sup>2</sup>. Based on the manufacturing process they are classified as:

Mono crystalline: efficiency of 12-14 %. These are now predominantly available in Market

Poly crystalline: efficiency of 12%

Amorphous: efficiency of 6-8%

Life of crystalline cells is in the range of 25 years whereas for amorphous cells it is in the range of 5 years.

PV Module: Series and parallel connected solar cells (normally of 36Wp rating).

PV Array: Series and parallel connected PV modules (generally consisting of 5 Modules).

### III. PROPOSED WORK

Maximum Power Point Tracker (MPPT) can be realized using different converter topologies. The MPPT design is explained below. The DC voltage transfer function is given by

$$\frac{V_o}{V_s} = \frac{1}{1-D}$$

Where  $V_o$  = output voltage,  $V_s$  = source voltage,  $D$  = duty cycle. The critical values of the inductance and capacitance can be calculated using the following equations,

$$L_b = \frac{(1-D)^2 DR}{2f}$$

## International Journal for Research in Applied Science & Engineering Technology (IJRASET)

$$C_{\min} = \frac{D}{2fR}$$

Here,  $f$  = frequency 10 kHz. The inductance and capacitance are calculated as  $L = 100 \mu\text{H}$ ,  $C = 220 \mu\text{F}$ .

Most of the cases the requirement of load voltage is greater than source voltage, because long series strings in SPVA may result in more power loss under partial shaded conditions.

An alternative and effective solution is provided by particle swarm optimization (PSO) based method which has fast computational capability and easy to implement due to its simple structure. In [11], the conventional PSO is implemented for MPPT with various extra coefficients, thus, the computational burden of the algorithm is increased.

Moreover, most of the PSO algorithms presented in previous works have been implemented and tested for two-stage PV system where the duty ratios are selected as PSO agents. This paper proposes a simple PSO based MPPT algorithm for a single-stage photovoltaic system, which is operated with other control. It is found that the modified PSO method tracks the MPP with fast speed and good accuracy.

The purpose of MPPT is to track the maximum power point (MPP) of PV characteristics, irrespective of variation in atmospheric conditions. In this paper, particle swarm optimization method is utilized for this purpose. The output of the MPPT controller gives the reference value ( $v_{dcref}$ ) for dc link voltage controller. PSO was developed by Eberhart and Kennedy in 1995 [15-16] inspired by social behavior of birds flocking or fish schooling. It is a meta-heuristic, population-based intelligence method that can be applied to optimization problem to search the optimal point. Particle Swarm has two primary operators: velocity update and position update. In each iteration each particle is accelerated toward the particle's previous best position ( $p_{best}$ ) and the global best position ( $g_{best}$ ). In each iteration a new velocity value for each particle is calculated based on its current velocity, the distance from its previous best position, and from the global best position. The new velocity value is, then, used to calculate the next position of the particle in the search space. This process is, then, iterated a set number of times or until a minimum error is achieved. By this process, all particles reach to a global optimal solution.

These points are expressed by the following equations which define the standard PSO method:

$$\lambda_i(k+1) = w\lambda_i(k) + c_1r_1 \cdot [p_{best,i} - s_i(k)] + c_2r_2 \cdot [g_{best} - s_i(k)]$$

$$s_i(k+1) = s_i(k) + \lambda_i(k+1)$$

where,  $s_i$  and  $\lambda_i$  are the position and velocity of  $i^{th}$  particle respectively;  $k$  denotes the iteration number;  $w$  is the inertia weight;  $r_1$  and  $r_2$  are random variables uniformly distributed within  $[0, 1]$ ;  $c_1$  and  $c_2$  are the acceleration coefficients;  $p_{best,i}$  is used to store the best position of  $i^{th}$  particle found so far and  $g_{best}$  is the best position of all particles in the entire population. The trajectory of typical particle movement for one iteration cycle is shown in Fig. 6. The positions of particles are adjusted if the following condition is satisfied:

$$f(s_i(k)) > f(p_{best,i})$$

where,  $f$  is the fitness value evaluation function (objective function) which is maximized in each iteration cycle till all the particles evolve to the optimal solution.

For MPPT, the position is defined as PV voltage ( $v_{pv}$ ) and the velocity is the perturbation in the reference voltage for the dc-link voltage controller. The solution vector of PV voltage ( $v_{pv}$ ) with  $N$  particles is defined as

$$s_i(k) = [v_{PV,1}, v_{PV,2}, v_{PV,3}, \dots, v_{PV,N}]$$

The objective function, which is to be maximized, is PV array power and the condition to be satisfied for particle position adjustment is

$$P_{PV}(v_{PV,i}(k)) > P_{PV}(v_{PV,i}(k-1))$$

## International Journal for Research in Applied Science & Engineering Technology (IJRASET)

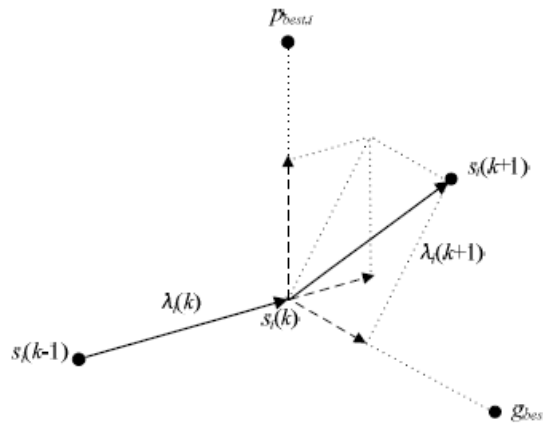


Figure 6.1: Particle movement trajectory in PSO search method

### IV. CONCLUSIONS

The electricity sector have many quandary regarding, the supply of electricity, so renewable energy advancement policies have increase the solar energy consumption. The consequential of photovoltaic cell connected to the grids. This work propose the single stage inverter with maximum power point tracking (MPPT) and one cycle controlled (OCC) for grid connected PV system. One cycle controlled scheme is predicated on the output current adjustment .Schemes predicated on one-cycle control (OCC) which do not require the accommodation of a phase locked loop for interfacing the inverter to the grid are increasingly being employed for such applications. It requires less no. of sensors (two) as compared to that required (four) in the earlier reported scheme for the implementation of the core controller comprising of OCC and MPPT blocks.

### V. ACKNOWLEDGMENT

We wish to acknowledge Michael Shell and other contributors for developing and maintaining the IEEE LaTeX style files which have been used in the preparation of this template. The other Contributors are mentioned in the references.

### REFERENCES

- [1] O. Ibadapo-Obe, O.O.E. Ajibola, Towards a Renewable Energy Development for Rural Power Sufficiency. International Conference on Innovations in Engineering and Technology. (2011)
- [2] O.I. Okoro, and E. Chikuni, Power sector reforms in Nigeria: opportunities and challenges. Journal of Energy in Southern Africa, vol.18, No. 3, pp.52-57 (2007)
- [3] Yankari-Reports: FG urges Nigerians to explore renewable energy for positive development. <http://yankarireports.com/fg-urges-nigerians-to-explore-renewable-energy-for-positive-development/> (2013) Accessed 21 June, 2013.
- [4] C. Meza, J. J. Negroni, D. Biel, and F. Guinjoan, —Energy-balance modeling and discrete control for single-phase grid-connected PV central inverters, I IEEE Trans. Ind. Electron., vol. 55, no. 7, pp. 2734–2743, Jul. 2008.
- [5] Trends in Photovoltaic Application, Survey Report of Selected IEA Countries Between 1992 and 2002 International Energy Agency Pho-tovoltaic Power System, IEA, Pvps t1-12:2003, 2003 -
- [6] K. Hemmes, —Towards multi-source multi-product and other integrated energy systems, I Int. J. Integr. Energy Syst., vol. 1, no. 1, pp. 1–15, Jan.–Jun. 2009.
- [7] F. Liu, Y. Zhou, S. Duan, J. Yin, B. Liu, and F. Liu, —Parameter design of a two-current-loop controller used in a grid-connected inverter system with LCL filter, I IEEE Trans. Ind. Electron., vol. 56, no. 11, pp. 4483–4491, Nov. 2009.
- [8] Azevedo, G.M.S., Cavalcanti, M.C., Oliveira, K.C., Neves, F.A.S. and Lins, Z.D., “Evaluation of maximum power point tracking methods for grid connected photovoltaic systems,” Conference on Power Electronics Specialists, 2008. PESC 2008. IEEE , August 2008, pp. 1456 - 1462.
- [9] Kjaer, S.B., Pedersen, J.K. and Blaabjerg, F., “A Review of single-phase grid connected inverters for photovoltaic modules,” Industry Applications, IEEE Transactions , vol. 41, September 2005, pp.1292-1306.
- [10] N. Femia, G. Petrone, G. Spagnuolo, and M. Vitelli, —Optimization of perturb and observe maximum power point tracking method, IEEE Trans. Power Electron., vol. 20, no. 4, pp. 963–973, Jul. 2005.
- [11] D. Fendri, M. Chaabene, Dynamic model to follow the state of charge of a lead-acid battery connected to photovoltaic panel. Energy Conversion and Management 64.587–593. (2012).
- [12] Ramaprabha R, Mathur BL. Soft computing optimization techniques for solar photovoltaic arrays. ARPN J EngApplSci 2011;6(10):70–5.
- [13] Ramaprabha R, Mathur BL. Development of an improved model of SPV cell for partially shaded solar photovoltaic arrays. Eur J Sci Res 2010;47(1):122–34.
- [14] V. V. R. Scarpa, S. Buso, and G. Spiazzi, “Low-complexity MPPT technique exploiting the PV module MPP locus characterization,” IEEE Trans. Ind. Electron., vol. 56, no. 5, pp. 1531–1538, May 2009.
- [15] Salas V, Olias E, Barrado A, Lazaro A. Review of the maximum power point tracking algorithms for stand-alone photovoltaic systems. Sol Energy Mater Sol

## International Journal for Research in Applied Science & Engineering Technology (IJRASET)

Cells 2006;90(11):1555–78

- [16] A. F. Williams, *The Handbook of Photovoltaic Applications: Building Applications and System Design Considerations*. Atlanta, GA: FairmontPress, 1986.
- [17] Dhople, S.V., Davoudi, A. and Chapman, P.L., "Dual stage Converter to improve transfer efficiency and maximum power point tracking feasibility in photovoltaic energy-conversion systems," *Applied Power Electronics Conference and Exposition (APEC)*, 2010 Twenty-Fifth Annual IEEE, March 2010, pp. 2138 - 2142.
- [18] Kasa N, Iida T, Chen L. Flyback inverter controlled by Sensorless current MPPT for photovoltaic power system. *IEEE Trans Ind Electron* 2005;52(4):1145–52.
- [19] Sera D, Kerekes T, Teodorescu R, Blaabjerg F. Improved MPPT method for rapidly changing environmental conditions. *Proc IEEE IntInd Electron Symp*2006;2:1420–5.



10.22214/IJRASET



45.98



IMPACT FACTOR:  
7.129



IMPACT FACTOR:  
7.429



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24\*7 Support on Whatsapp)