



# IJRASET

International Journal For Research in  
Applied Science and Engineering Technology



---

# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

---

**Volume: 5      Issue: VIII      Month of publication: August 2017**

**DOI: <http://doi.org/10.22214/ijraset.2017.8273>**

**[www.ijraset.com](http://www.ijraset.com)**

**Call:  08813907089**

**E-mail ID: [ijraset@gmail.com](mailto:ijraset@gmail.com)**

# Advanced Fuzzy Logic Control system for Thermal Power Plant

Rajesh Singh Shekhawat<sup>1</sup>, Dr. Shelly Garg<sup>2</sup>

<sup>1</sup>Research scholar, Department of Electrical Engineering, <sup>2</sup>Principal, IJET Kurusetra University, Kurushetra & University, Haryana, INDIA

**Abstract:** An objective of this paper is too familiar with fuzzy logic and fuzzy modeling. Its incorporation in embedded systems could lead to enhanced performance, increased simplicity and productivity, reduced cost and time to- market, along with other benefits in power system. In this paper, we try to explain fuzzy logic control for AGC and comparing with other controlling methods like PID, Type-1 FLC. Where we calculate the comparison overshoot, undershoot and settling time in controlling system.

**Keywords:** Proportional Integral (PI), Automatic Generation Control (AGC), Fuzzy Logic control (FLC), Fuzzification, De-fuzzification.

## I. INTRODUCTION

In the fuzzy logic controller is proposed to solve the load frequency control problem of single area power system and two area system and compared with a conventional PI controller. It is found that performance of type-1 FLC is better than the conventional PI controller in terms of peak overshoot, a number of oscillations and settling time but it is not sufficient for fulfilling the requirements of the future power system, so we have to design an advanced controller which gives fast response. To overcome the drawbacks of fuzzy logic controller used in the previous chapter, a new fuzzy logic controller approach is investigated in this Paper. This fuzzy approach handles all these problems of fuzzy controller easily and efficiently.

## II. TYPE-2 FUZZY LOGIC CONTROLLER FOR AGC

### A. Structure of Type-2 FLC

Generally, a controller design based on fuzzy logic for a dynamical system involves the following four main steps.

Understanding the system dynamic behavior and characteristics which define the states and input/output control variables and their variation ranges.

Establish applicable fuzzy sets and membership functions to form the degree of fuzzy membership function for every input/output variable and complete fuzzification.

Construct the fuzzy rule base, using the control rules that the system will operate under. Decide however the action will be executed by assigning strengths to the rules.

Determine de-fuzzification technique, combine the rules and de-fuzzify the output.

Hence, above discussion based fuzzy logic approach, a controller named type-2 fuzzy logic controller is investigated as shown in figure 1. It has two inputs, error and differential error and an output is integrated. Value of scaling factors  $K_e$ ,  $K_{ce}$  and  $K_{pu}$  can be tuned by using IASE, PSO, GA or manually.

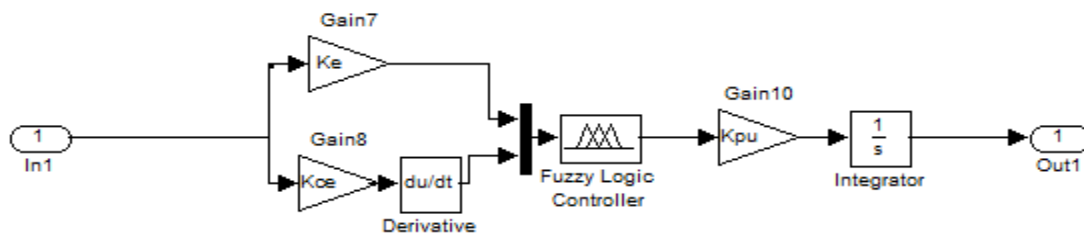


Figure 1 Type-2 fuzzy logic controller model

**B. Rule Base and Fuzzy Sets for type-2 Fuzzy Logic Controller**

Similar to type-1 fuzzy logic controller, type-2 FLC also based on 49 rules. These fuzzy logic rules are in “if and then” format. These rules can be placed in form of table (as in table 1). Here error and differential error are two inputs of fuzzy logic controller as given in figure 1.

TABLE 1  
Fuzzy logic controller rule base

Error	differential Error							
	NB	NM	NS	Z	PS	PM	PB	
NB	PB	PB	PM	PM	PS	PS	Z	
NM	PB	PB	PM	PM	PS	Z	Z	
NS	PB	PM	PM	PM	Z	NS	NS	
Z	PB	PM	PM	Z	NS	NM	NB	
PS	PM	PM	NS	NS	NM	NB	NB	
PM	PS	PS	NS	NM	NB	NM	NB	
PB	NS	NS	NM	NM	NM	NM	NB	

Here we will use triangular membership function for input and output. Range of type-2 fuzzy logic controller is taken same as type-1 fuzzy logic controller, input error is taken from -0.8 to +0.8, differential error is -1.5 to +1.5 and output control action is taken from -0.015 to +0.015.

**III. DYNAMIC RESPONSE OF SINGLE AREA THERMAL SYSTEM USING TYPE-2 FLC**

The above developed controllers have been used for load frequency control of single area thermal system. In starting, the performance of fuzzy logic controller (FLC) has been tested for a disturbance of 1% step change in load in single area thermal system. The above described single area thermal system has been implemented in Simulink/Matlab with FLC as shown in Figure 2. Simulation result as deviation in frequency of this system is given in figure 3; also the result is compared with PID and type-1 fuzzy logic controllers as shown in figure 11.

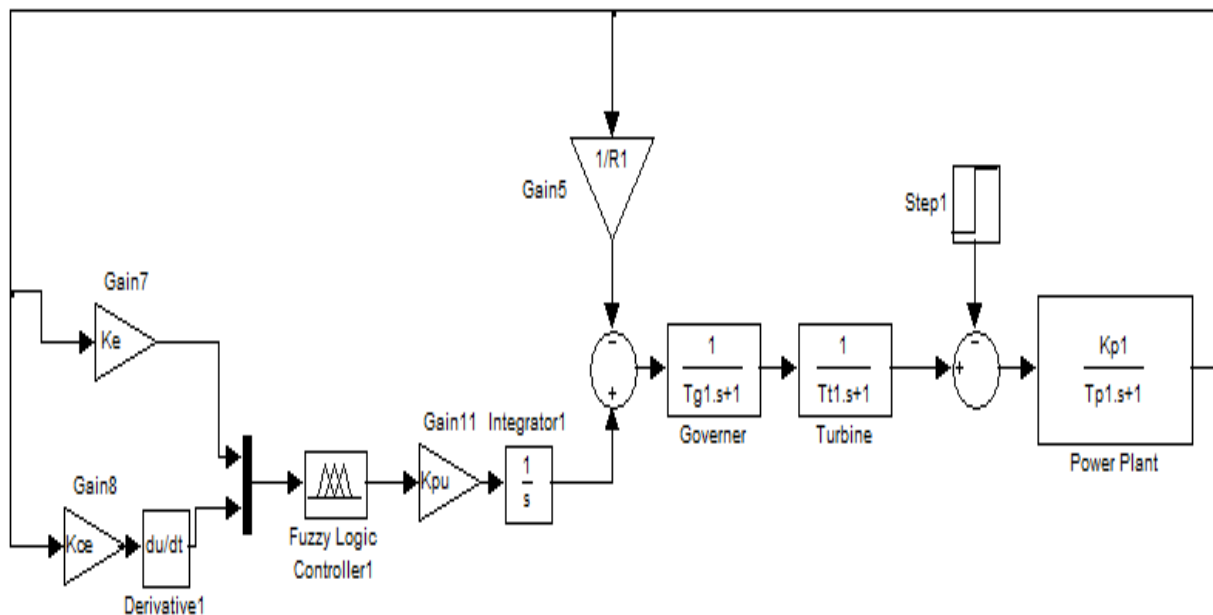


Figure 2 Implementation of Fuzzy logic controlled in single area Thermal System

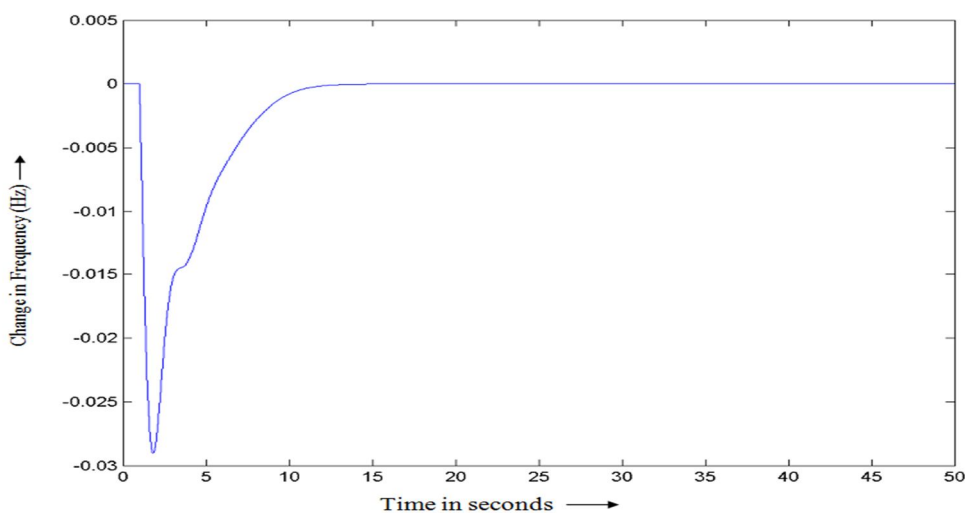


Figure 3 Deviation in frequency of single area Thermal System with type-2 FLC

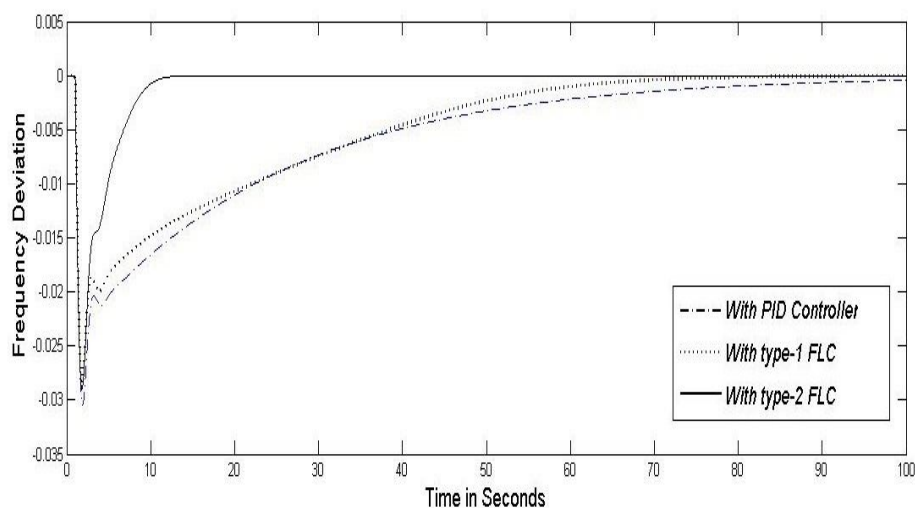


Figure 4 Comparison of frequency deviation for single area thermal with PID, type-1 and type-2 FLC

From the simulation results, It is found that type-2 fuzzy logic controller gave better results in terms of less deviation in frequency in first undershoot, overshoot, less settling time, and less oscillations as compared to type-1 fuzzy logic controller and conventional PID controllers which is given in table 2.

TABLE 2

Time analysis parameters of simulations of single area Thermal system

Parameters	System With PI Controller	System With Type-1 Fuzzy logic Controller	System With Type-2 Fuzzy logic Controller
Undershoot(Hz)	0.031	0.028	0.028
Overshoot(Hz)	0	0	0
Settling time(sec)	90	60	10

#### IV. DYNAMIC RESPONSE OF TWO AREA THERMAL SYSTEM USING TYPE-2 FLC

This section deals with a two area system simulation in Simulink/Matlab consisting of a thermal system as shown in Figure 5. Now the PID, type-1 fuzzy logic controller and type-2 fuzzy logic controllers have been tested and compared for 1% disturbance in area1, the simulation results shown in Figure 6 to 11.

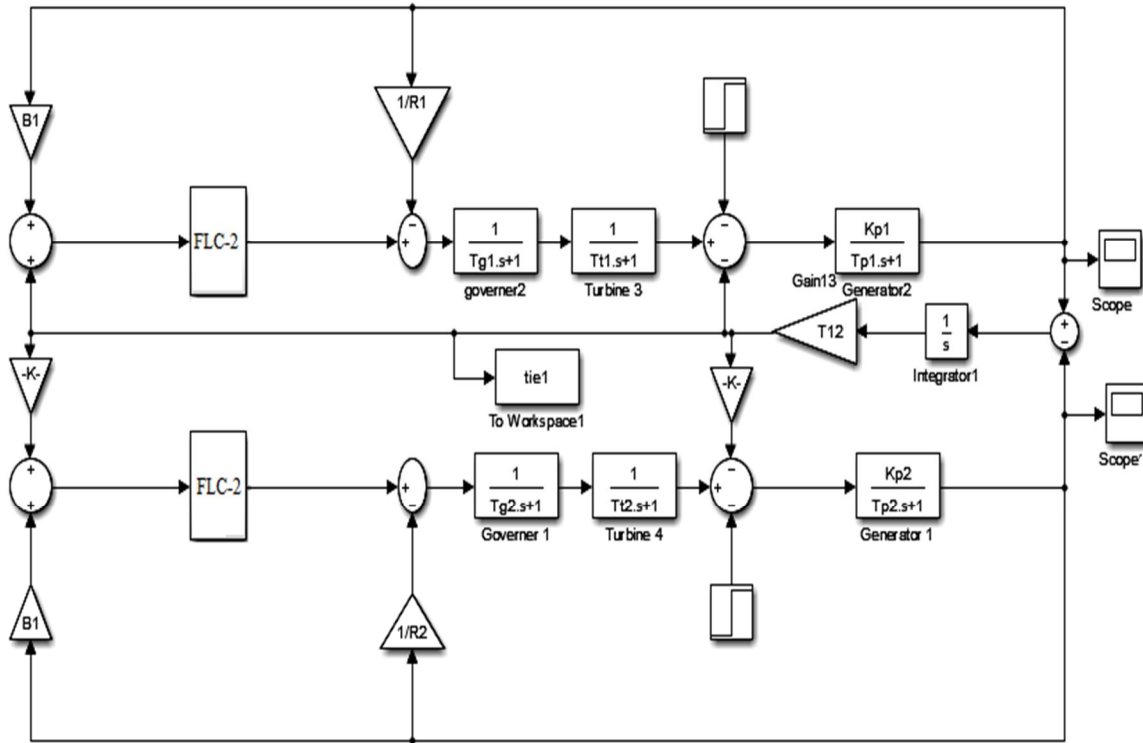


Figure 5 Simulation model of Fuzzy logic controlled two area Thermal System

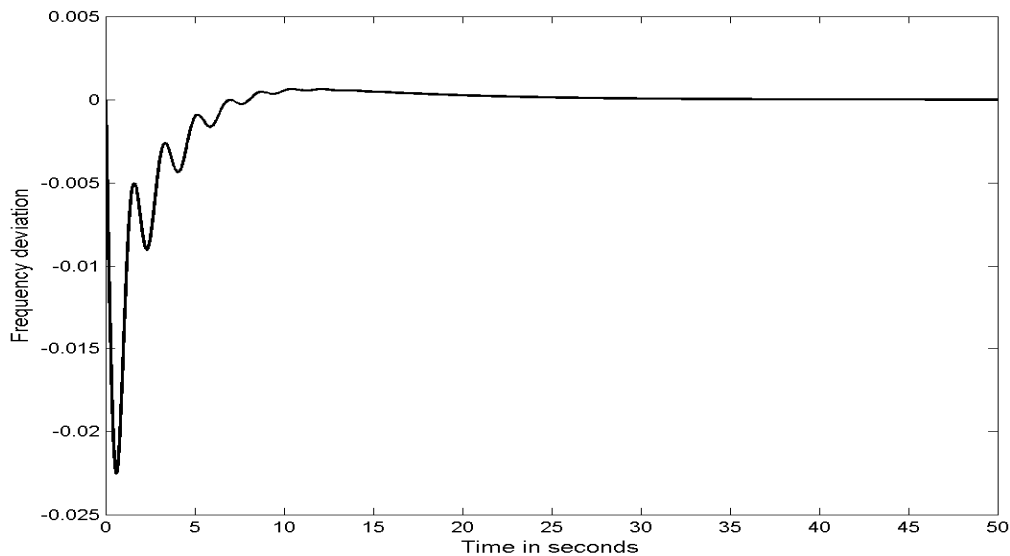


Figure 6 Deviation in frequency of area-1 of a two area Thermal System with type-2 FLC

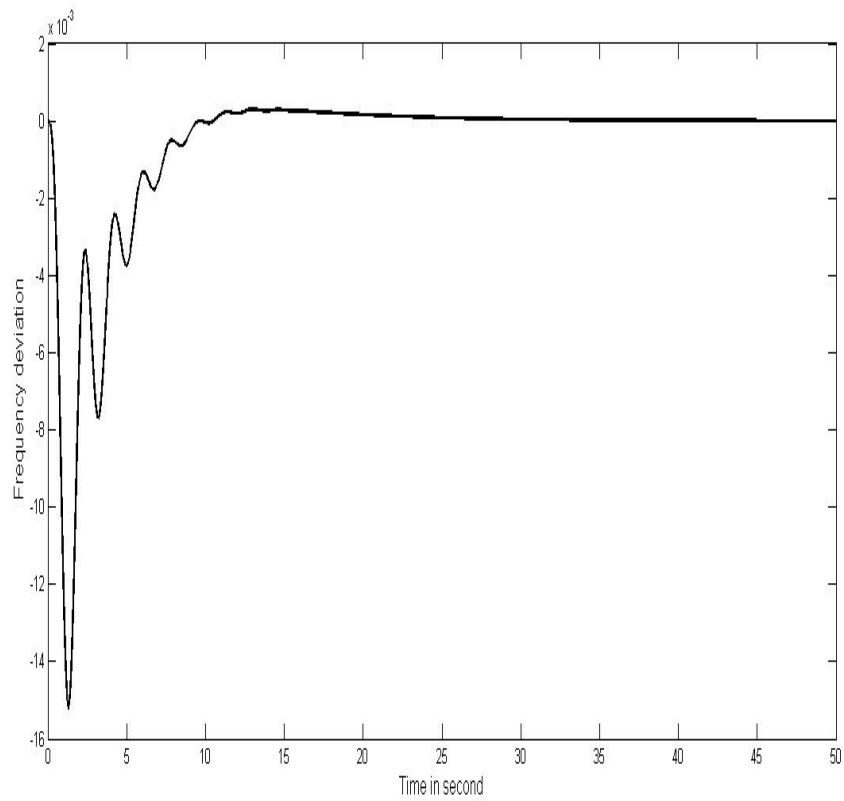


Figure 7 Deviation in frequency of area-2 of a two area Thermal System with type-2 FLC

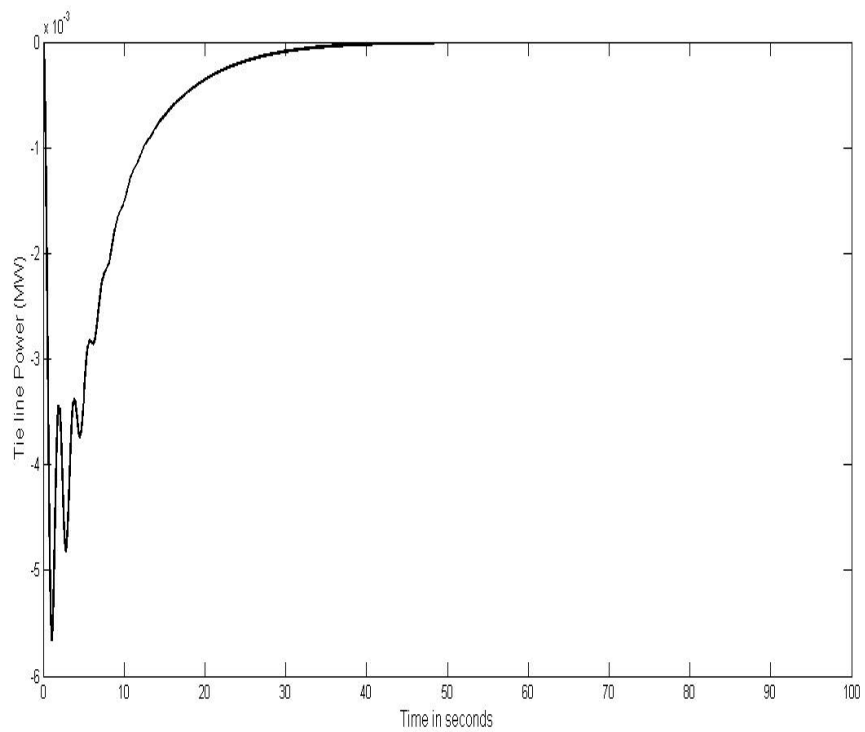


Figure 8 Deviation in tie line power of a two area Thermal System with type-2 FLC

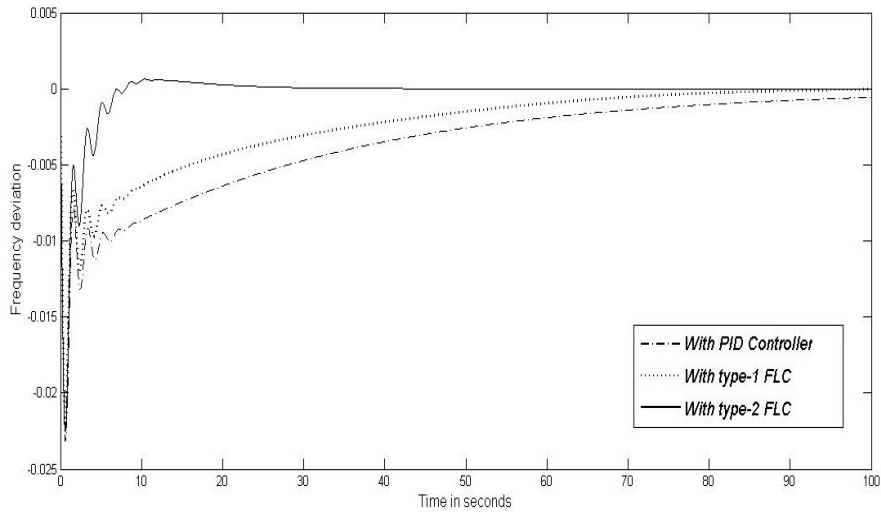


Figure 9 Comparisons of deviation in frequency of area-1 of a two area Thermal-Thermal System

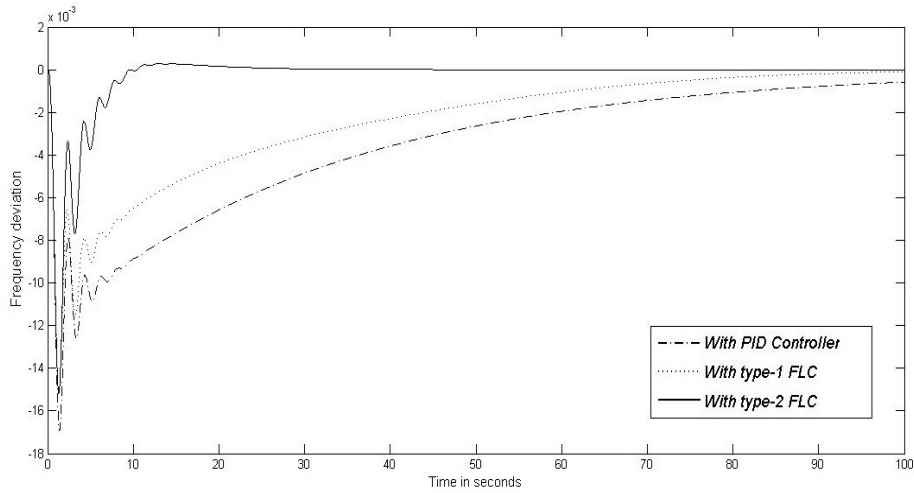


Figure 10 Comparisons of deviation in frequency of area-2 of a two area Thermal-Thermal System

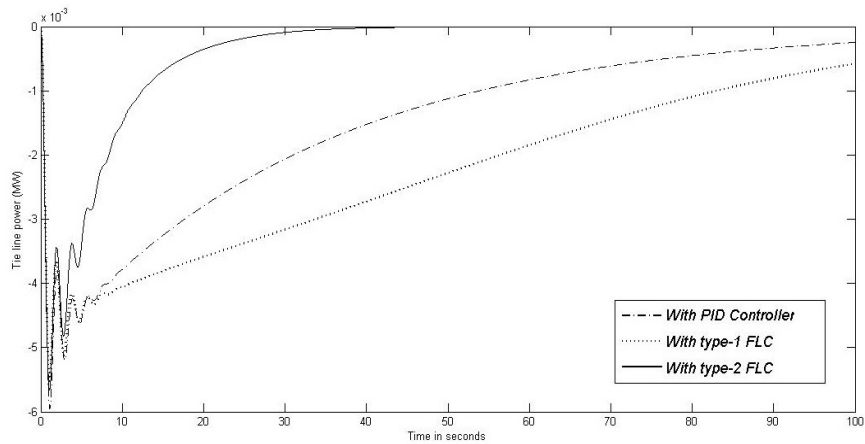


Figure 11 Comparison of deviation in tie line power of a two area Thermal System

From the simulation results, It is found that type-2 fuzzy logic controller gave better results in terms of less deviation in frequency in first undershoot, overshoot, less settling time, and less oscillations as compared to type-1 fuzzy logic controller and conventional PID controllers which is given in table 3 to 5.

TABLE 3

Time analysis parameters of simulations of area1 for Thermal-Thermal system when 1% disturbance in area1

Parameters	System With PI Controller	System With Type-1 Fuzzy logic Controller	System With Type-2 Fuzzy logic Controller
Undershoot(Hz)	0.023	0.022	0.022
Overshoot(Hz)	0	0	0.001
Settling time(sec)	100	60	30

TABLE 4

Time analysis parameters of simulations of area 2 for Thermal-Thermal system when 1% disturbance in area1

Parameters	System With PI Controller	System With Type-1 Fuzzy logic Controller	System With Type-2 Fuzzy logic Controller
Undershoot(Hz)	0.017	0.015	0.015
Overshoot(Hz)	0	0	0.001
Settling time(sec)	110	70	30

TABLE 5

Time analysis parameters of simulations of tie line for Thermal-Thermal system when 1% disturbance in area1

Parameters	System With PI Controller	System With Type-1 Fuzzy logic Controller	System With Type-2 Fuzzy logic Controller
Undershoot(Hz)	0.0060	0.0055	0.0055
Overshoot(Hz)	0	0	0
Settling time(sec)	120	130	30

### V. CONCLUSION

In this paper, a type-2 fuzzy logic controller has used to solve the load frequency control problem of single area power system and two area system. A simulation study of single and two area systems with conventional PID controller, type-1 fuzzy logic controller, and a type-2 fuzzy logic controller is proposed and compared their performance. Hence, the performance of the type-2 fuzzy logic controller is found superior in terms of peak overshoot, number of oscillations and settling time.

### VI. ACKNOWLEDGMENT

This research paper was supported by B. K. Birla Institute of Engineering & Technology, Pilani. We thank to Dr. P. S. Bhatnagar from (Director, BKBIET, Pilani) who provided perceptions and expertise that assisted the research in a very precise manner. I would also like to show our gratitude to the Dr. Shelly Garg (Principal, IIET) for sharing their pearls of intelligence with us during the course of this research. I am also immensely grateful to Dr. Shelly Garg my guide for their remarks on an earlier version of the manuscript.



## REFERENCES

- [1] Rajesh Singh Shekhawat, Dr. Shelly Garg "Automatic Generation Control—An Enhanced Review", International Journal of Engineering Trends and Technology (IJETT), V50(2),75-84 August 2017. ISSN:2231-5381. www.ijettjournal.org. published by seventh sense research group
- [2] P.S.R. MURTHY, "Power System Operation and Control" McGraw Hill Publication, 1984.
- [3] D. P. KOTHARI and I. J. NAGRATH, "Modern Power System Analysis" McGraw Hill Publication, 1989.
- [4] Lee, C. C. " Fuzzy logic in control systems: Fuzzy logic control, part I" *IEEE Transactions on Systems, Man, and Cybernetics*, SMC 20, , pp. 404-418, 1990.
- [5] P. Kundur "Power System Stability and Control" Mc-Graw-Hill publication, 1994.
- [6] D. M. Vinod Kumar, "Intelligent controllers for Automatic Generation Control" IEEE, pp 557-574, 1998.
- [7] Bjorn H. Bakken and Ove S. Grande, "Automatic Generation Control in a Deregulated Power System" IEEE Transactions on Power Systems, Vol. 13, No. 4, pp 1401-1406, November 1998.
- [8] Alfred L. Guiffrida, Rakesh Nagi "Fuzzy set theory applications in production management research" a literature survey, *Journal of Intelligent Manufacturing*, Volume 9, Issue 1, pp 39-56, 1998.
- [9] George Gross and Jeong Woo Lee "Analysis of Load Frequency Control Performance Assessment Criteria" IEEE transactions on power systems, vol. 16, no. 3, pp 520-525 August 2001.
- [10] Katsuhiko Ogata "Modern Control Engineering" Fourth Edition 2002.
- [11] J. Nanda, M. Parida and A. Kalam "Automatic generation control of a multi-area power system with conventional integral controllers" Melbourne, Australia TS13-Load and Frequency Control, vol. 2, In: Proc. AUPEC 2006.
- [12] Janardan Nanda, Ashish Mangla, and Sanjay Suri, "Some New Findings on Automatic Generation Control of an Interconnected Hydrothermal System With Conventional Controllers" IEEE Transactions on energy conversion, vol. 21, no. 1, pp 187-194, March 2006.
- [13] M.F. Hossain, T. Takahashi, M.G. Rabbani, M.R.I. Sheikh and M.S. Anwer "Fuzzy-Proportional Integral Controller for an AGC in a Single Area Power System" 4th International Conference on Electrical and Computer Engineering ICECE 2006, pp 120-123, December 2006.
- [14] Ker-Wei Yu, Jia-Hao Hsu "Fuzzy Gain Scheduling PID Control Design Based on Particle Swarm Optimization Method" Second International Conference on Innovative Computing, Information and Control, ICICIC.2007: 337-340, 2007
- [15] Xinyi Ren, Fengshan Du, Huagui Huang, Hongyan Yan "Application of Fuzzy Immune PID Control Based on PSO in Hydraulic AGC Press System" International Conference on Intelligent Human-Machine Systems and Cybernetics, Hangzhou, Zhejiang, pp: 427 - 430, 2009.
- [16] S.K. Sinha, R.N.Patel, R.Prasad "Application of GA and PSO Tuned Fuzzy Controller for AGC of Three Area Thermal-Thermal-Hydro Power System" International Journal of Computer Theory and Engineering, 2(2): pp: 1793-8201, 2010.
- [17] Guolian Hou, Lina Qin, Xinyan Zheng,Jianhua Zhang "Design of PSO-Based Fuzzy Gain Scheduling PI Controller for Four-Area Interconnected AGC System after Deregulation" Proceedings of the 2011 International Conference on Advanced Mechatronic Systems, Zhengzhou, China, August 11-13, 2011
- [18] Hassan Bevrani, Senior Member, *IEEE*, and Pourya Ranjbar Daneshmand, "Fuzzy Logic-Based Load-Frequency Control Concerning High Penetration of Wind Turbines" IEEE SYSTEMS JOURNAL, VOL. 6, NO. 1, MARCH 2012
- [19] Anju G Pillai, Meera Rose Cherian, Sarin Baby, Anish Benny "Performance Analysis of Conventional and Intelligent Controllers In Power Systems With AGC," International Journal Of Scientific & Engineering Research, Volume 4, Issue 8, August 2013
- [20] Roohi Kansall Balwinder Singh Surjan, "Study of Load Frequency Control in an Interconnected System Using Conventional and Fuzzy Logic Controller," international Journal of Science and Research (IJSR), Volume 3 Issue 5, May 2014
- [21] Ramandeep Kaur, Jaspreet kaur, "PID Controller Based AGC under Two Area Deregulated Power System," International Journal of Scientific & Engineering Research, Volume 6, Issue 6, June-2015
- [22] D. K. Sambariya, Vivek Nath, "Optimal Control of Automatic Generation with Automatic Voltage Regulator Using Particle Swarm Optimization" Universal Journal of Control and Automation 3(4): pp 63-71, 2015
- [23] Animesh Kumar Paul1, Pintu Chandra Shill2 "Optimizing Fuzzy Membership Function using Dynamic Multi Swarm – PSO" 5th International Conference on Informatics, Electronics and Vision (ICIEV), Department of Computer Science and Engineering Khulna University of Engineering and Technology Khulna, Bangladesh. 2016



10.22214/IJRASET



45.98



IMPACT FACTOR:  
7.129



IMPACT FACTOR:  
7.429



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24\*7 Support on Whatsapp)